


ISOMETRIC VIEW

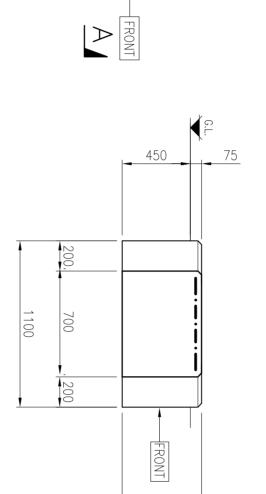

525

1800

600

1 LAYER A393 MESH TOP (MINIMUM COVER 40mm)

 \triangleright

600

 \Box

1100

600

 \Box


SECTION A-A

PLAN

1100

700

200

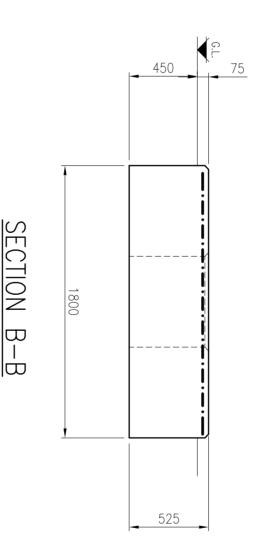

SITE NOTES

- 1. CONTRACTOR TO OBTAIN UNDERGROUND CABLE & SERVICE RECORDS PRIOR TO COMMENCEMENT OF ANY WORKS.

 2. THE CONTRACTOR MUST ASSUME THAT ANY EXISTING CABLES LOCATED WITHIN THE WORKS ARE LIVE AND LAISE WITH THE ELECTRICITY NORTH WEST ENGINEER FOR ADVICE.

 3. SITE SPECIFIC RISK ASSESSMENT TO BE UNDERTAKEN PRIOR TO COMMENCEMENT OF ANY WORKS.

 4. FOUNDATION DESIGN HAS BEEN BASED ON A SUITABLE BEARING PRESSURE FOR MOST GROUND CONDITIONS INCLUDING CLAYS. FORMATION LEVEL FOR FOUNDATIONS TO BE TAKEN DOWN TO GROUND THAT IS SUFFICIENTLY FIRM TO PROVIDE PHYSICAL SUPPORT TO THE STRUCTURE.

 5. FOUNDATION FORMATION LEVELS TO BE INSPECTED AND APPROVED PRIOR TO FOUNDATION

 CONSTRUCTION.

GENERAL NOTES

N →

3.

- DO NOT SCALE.
 ALL DIMENSIONS ARE IN MILLIMETRES UNLESS
 NOTED OTHERWISE.
 THIS DRAWING IS TO BE READ IN
 CONJUNCTION WITH ELECTRICITY NORTH WEST CODE OF
 PRACTICE ES352
 ALL WORK TO BE CARRIED OUT IN ACCORDANCE
 WITH CURRENT BUILDING REGULATIONS AND
 RELEVANT BRITISH STANDARDS AND CODES OF PRACTICE.
 CONCRETE TO BE STRENGTH CLASS C32/40 TO BS8500

- FREDERICK ROAD, SALFORD M6 6QH M6 6QH TEL 0161 6041370
- SITE NAME P.F.R. NO. DWG NO CIVIL DISTRIBUTION SUBSTATION
 PLINTH FOR FREE STANDING
 CABLE CONNECTED 315/1000KVA
 TRANSFORMER - | DWG STATUS | APPROVA 900350-015 | **REV** | 1