

<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 1 of 39

Harmonic Measurement Survey Report

at

Dunton Green

Report prepared by:

S Joyce

Power Quality Area Engineer

ABB Ltd

Rossmore Road East

Ellesmere Port

Wirral

CH65 3DD

Tel 0151 357 8400

<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 2 of 39

Contents

Terminology	3
Harmonic Theory	4
Introduction	7
Basic Data	8
Analyser Configuration	9
Timeplot - Voltage	10
Timeplot - Current	12
Timeplot - Active Power kW	14
Timeplot - Apparent Power kVA	16
Timeplot - Reactive Power kVAr	18
Timeplot - ThdV	20
Timeplot - ThdI	22
Timeplot - Voltage Spectra 150hz	24
Timeplot - Voltage Spectra 250hz	26
Timeplot - Voltage Spectra 350hz	28
Timeplot - Voltage Spectra 450hz	30
Timeplot - Current Spectra 150hz	32
Timeplot - Current Spectra 250hz	34
Timeplot - Current Spectra 350hz	36
Timeplot - Current Spectra 450hz	38

<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 3 of 39

Terminology

A number of standards, terms and abbreviations are used to compile this report; the full descriptions are detailed below.

Term/abbreviation	Description
BS-EN 50160:2000	Voltage Characteristics of Electricity Supplied by Public Distribution Systems.
BS-EN 61000-4-7:2002	Electromagnetic Compatibility (EMC) General Guide on harmonics and interharmonics measurements and instrumentation, for power supply systems and equipment connected thereto
IEC 61000-4-30:2003	Electromagnetic Compatibility (EMC) Testing and measurement techniques – Power quality measurement methods
G5/4-1	Energy Networks Association Engineering Recommendation G5/4-1 Dated October 2005“Planning Levels for Harmonic Voltage Distortion and the Connection of Non-Linear Equipment to Transmission Systems and Distribution Networks in the United Kingdom.”
ETR 122	Energy Networks Association Engineering Technical Report ETR122 Dated February 2003 “Guide to the Application of Engineering Recommendation G5/4 in the Assessment of Harmonic Voltage Distortion and Connection of Non-Linear Equipment to the Electricity Supply System in the UK.
EMC	Electromagnetic Compatibility – harmonics are low frequency conducted emissions.
Fault Level	The power that will flow in a short circuit condition in a network, this gives a guide to the network impedance.
Harmonic	The harmonic components in a line voltage or current when subjected to a fourier analysis. Principle harmonics in the public supply network are odd integers and are measured up to the 50 th .
NOC	Network Operating Company (the electricity supply company who provide the connection to the network, not necessarily the clients electricity vendor)
MCC	Motor Control Centre
PCC	Point of Common Coupling – the point at which other consumers are connected to the public electricity supply

<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 4 of 39

Harmonic Theory

Basics

Many modern electrical and electronic products incorporate rectifiers, which take a non-linear current from the power supply.

There are a number of different methods of rectification that can be considered, the most common are uncontrolled (a number of diodes connected in a bridge), controlled (a number of thyristors connected in a bridge), and active (a number of IGBTs connected in a bridge).

These currents take the form of repetitive waveforms that can be subject to a fourier analysis to determine the magnitude and angle of each harmonic component. Each type of device will produce a characteristic harmonic spectrum, which will vary with bridge design, levels of filtering and source impedance. As the current will be drawn through the impedance of the supply network it will generate a complementary voltage distortion spectrum.

Typical effects of harmonics are detailed in the table below:-

Effects of high harmonic currents

- Overheating of conductors
- Insulation failure
- Nuisance tripping of circuit breakers
- Nuisance rupturing of fuses
- Additional significant voltage distortion of networks run from generators
- Overheating and possible resonance on networks using capacitors

- Overloaded neutral
- Neutral earth potential
(generally due to single phase harmonic loads)

- PC/TV monitor stroboscopic effects
- Malfunction of microprocessor based equipment

Effects of high harmonic voltage distortion

- Causes linear devices to draw non linear current (ie- motors)
- Torque pulsations in motors
- Flicker in lighting
- Capacitor di-electric failure
- Insulation breakdown
- PC/TV monitor and power supply failure
- Electronic lighting failure

Customer ENW		ABB Ref.	
Project Dunton Green Harmonic Survey		Cust. Ref.	
Dealt with by SCJ	Date 27/03/2014	Issue 0	Page 5 of 39

Current Distortion

Both single and three phase non-linear loads draw harmonic currents. For both controlled and uncontrolled rectifiers the dominant harmonic is generally denoted by n-1, where n is the number of rectifying devices, ie a single phase 4 diode rectifier gives a dominant 3rd. harmonic, and a three phase 6 diode rectifier gives a dominant 5th, harmonic.

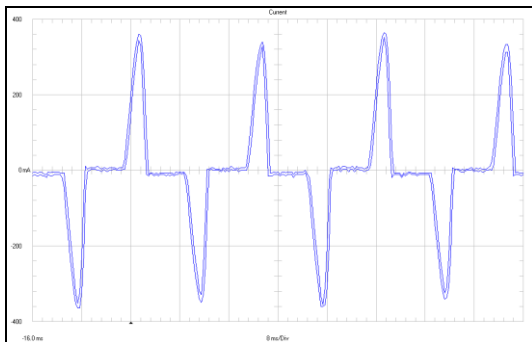


Figure 1

Typical measured current waveform for single phase uncontrolled rectifier

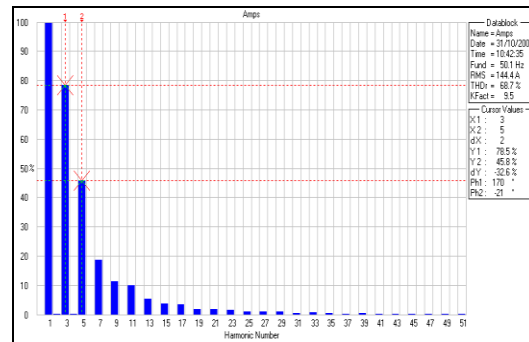


Figure 2

Typical measured harmonic current spectrum for single phase uncontrolled rectifier

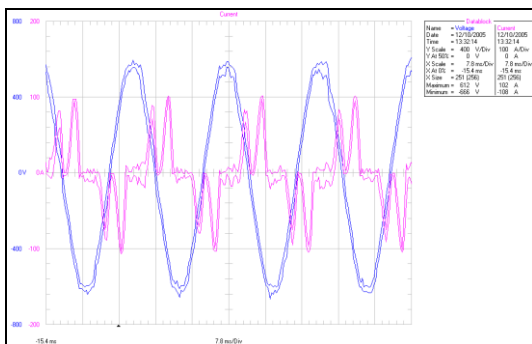


Figure 3

Typical current and voltage waveform for 6 pulse uncontrolled rectifier

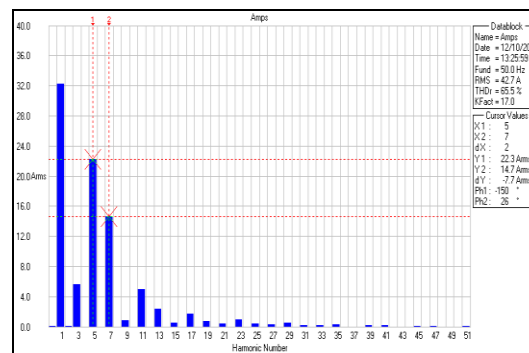


Figure 4

Typical current spectrum analysis for 6 pulse uncontrolled rectifier

Voltage Distortion

Voltage distortion propagates throughout the entire distribution network, and must be regulated by the distributor to avoid the damaging effects.

The magnitude of the distortion is dependent on the current and the network impedance, and the lower the network impedance (higher fault level), the lower the resultant voltage distortion.

<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 6 of 39

The levels of acceptable distortion are laid down in a number of standards including EN 50160, and IEC 61000 series.

Harmonic flow

In theory a current will flow to the lowest impedance, hence it would be expected that harmonic current flow would be up through the increasing voltage levels of the network, however, if there are any resonant components in a network at lower voltage level, such as power factor correction, there can be a flow in this direction.

Limits for Harmonic Voltage & Current

In the UK the network operators are governed by statutory instruments which specify the levels of service and network power quality and forms part of their license agreement.

Part of the power quality requirements are incorporated in an installation standard known as the Energy Networks Association Engineering Recommendation G5/4-1 – Planning levels for harmonic voltage distortion and connection of non-linear equipment to transmission systems and distribution networks in the UK.

This gives a number of Stages that can be applied to connections for consumers, and a guide to its application is available from www.gambica.org.uk.

<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 7 of 39

Introduction

The objective of the survey is to carry out a power quality survey at Dunton Green.

Measurements were made for 7 days from 22/03/2012 11:20:08.0 to 29/03/2012 10:14:16.0

Site Data

The site is located at main incomer.

<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 8 of 39

Basic Data

1.	Company (submitting the report)	ENW
2.	Contact Name and Address	Gavin Anderson Tel: +44 (0) 161 604 1380
3.	Site address	Dunton Green
4.	Metering Point Account Number	N/A
5.	Network connection (where known)	N/A
6.	Transformer details (where relevant)	N/A
7.	Reason for the survey	<i>Power Quality Survey</i>
8.	Existing non linear load	Non-Linear Load
9.	Details of new non linear load	N/A
10.	Point of measurement	<i>415V Main Incomer</i>
11.	Measurements	<i>Power Quality</i>
12.	Connection Arrangements	4 WIRE / 3 PROBE (WYE)
13.	Measuring instrument	<i>Dranetz PX5</i>
14.	Start time for measurements	22/03/2012 11:20:08.0
15.	Finish time for measurements	29/03/2012 10:14:16.0

<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 9 of 39

Instrument Configuration

Dranetz Power Xplorer Configuration

Firmware Power Xplorer (c) 2009 Dranetz-BMI
Oct 14 2010 @ 11:37:27
Ver.: V 4.2, Build: 7, DB ver.: 0

Site/Filename DUNTON GREEN
Measured from 22/03/2012 11:20:08
Measured to 29/03/2012 10:14:16.0
File ending OK
Synchronization Standard A
Configuration 4 WIRE / 3 PROBE (WYE)
Monitoring type STANDARD PQ
Nominal voltage 240.0 V
Nominal current 52.4 A
Nominal frequency 50.0 Hz

Use inverse sequence No
Using currents Yes
Characterizer mode IEEE 1159

Current probes

Chan A RR3035 (Range3), 3000A (Scale=1000.00)
Chan B RR3035 (Range3), 3000A (Scale=1000.00)
Chan C RR3035 (Range3), 3000A (Scale=1000.00)
Chan D Other (Scale=1.00)

Voltage scale factors

Chan A 1.000
Chan B 1.000
Chan C 1.000
Chan D 1.000

Current scale factors


Chan A 1.000
Chan B 1.000
Chan C 1.000
Chan D 1.000

Trigger Response Setups

Summary Pre-trigger cycles 6 cycles
Summary Post-trigger cycles IN-TO-OUT 6 cycles
Summary Post-trigger cycles OUT-TO-IN 6 cycles
Waveform Pre-trigger cycles 1 cycles
Waveform Post-trigger cycles 2 cycles


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 10 of 39

Timeplot
Voltage RMS value

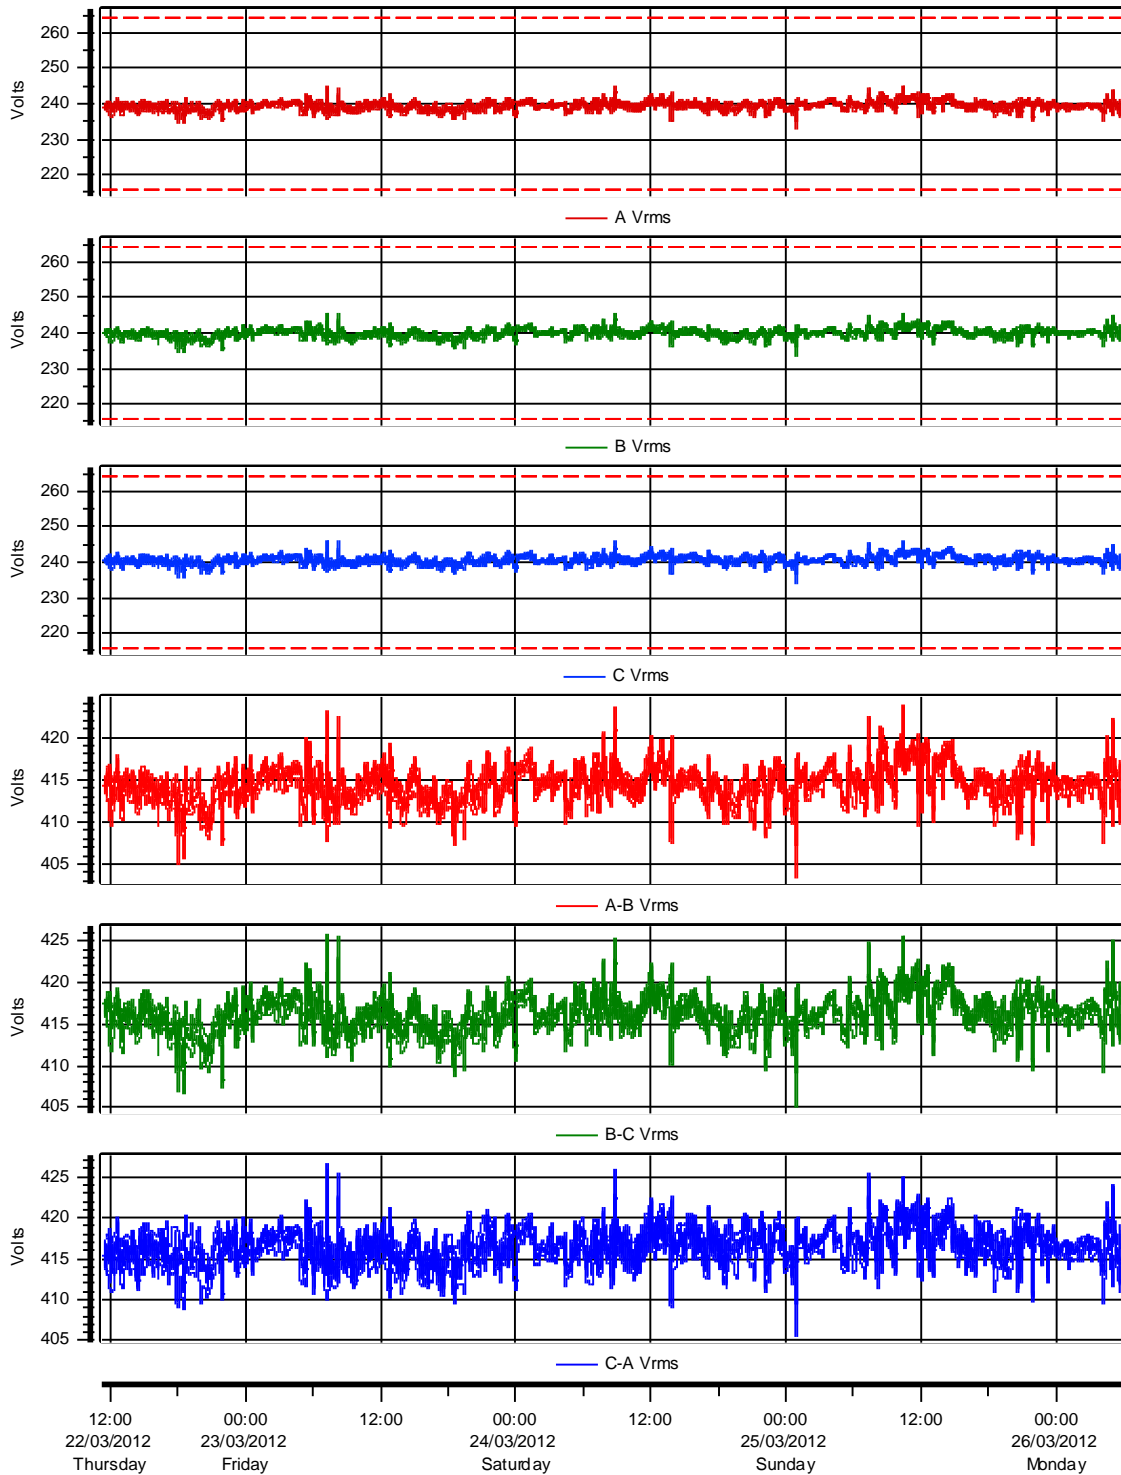


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 11 of 39

Timeplot
Voltage RMS value

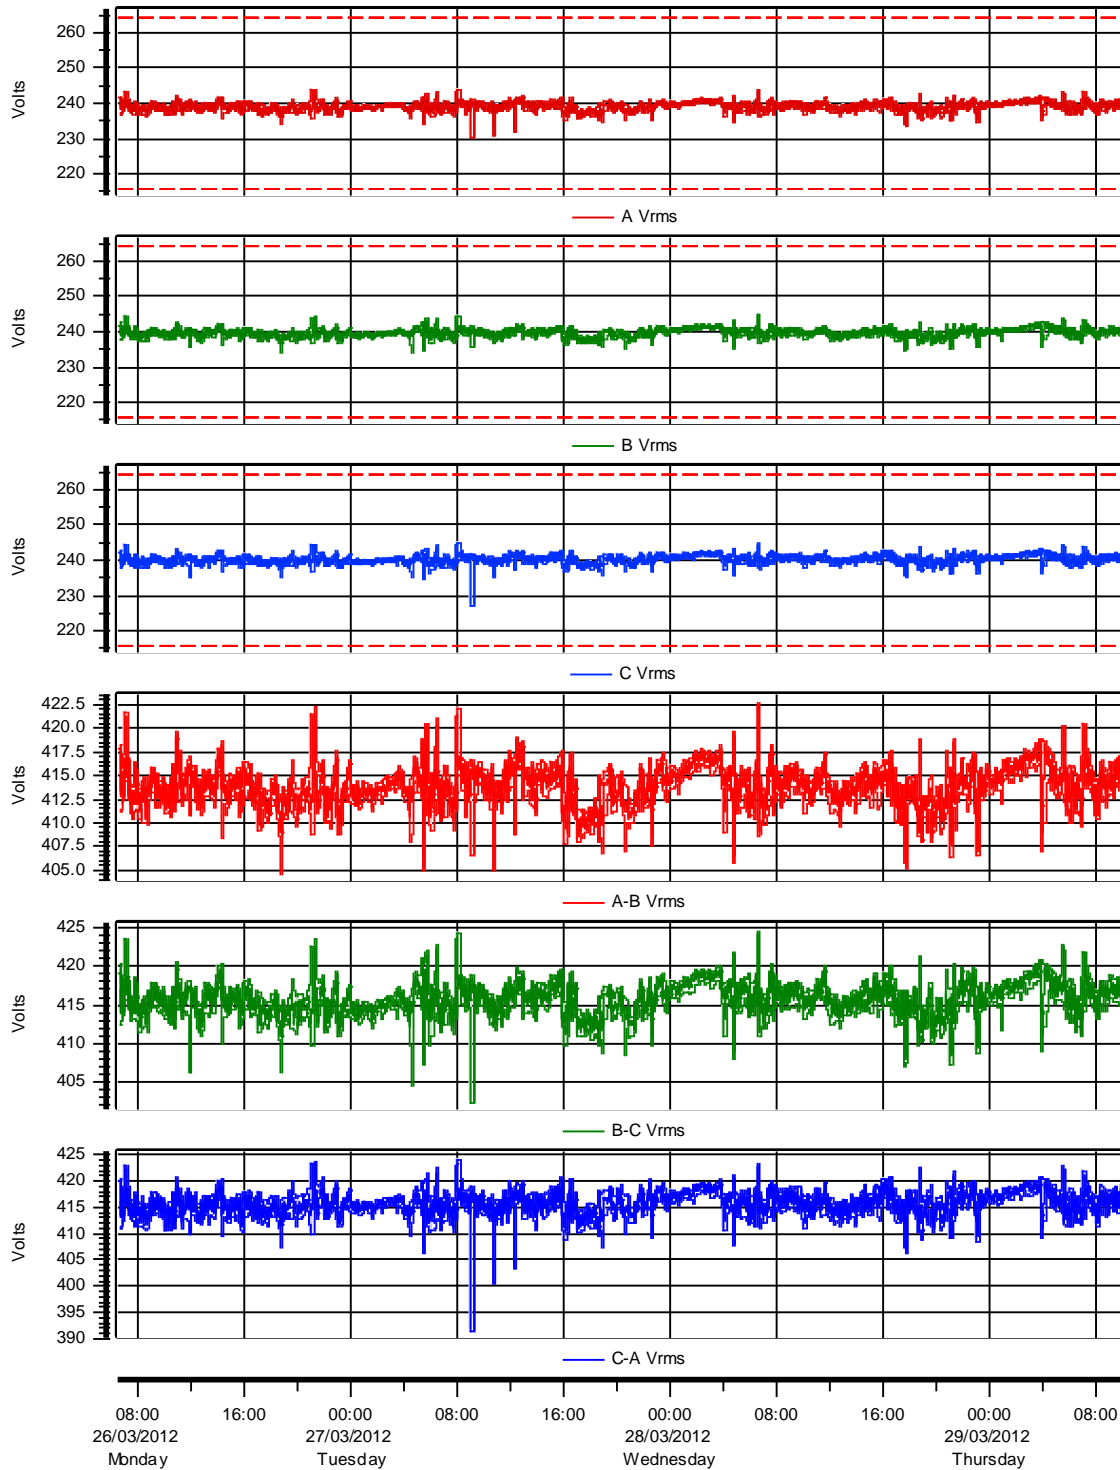


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 12 of 39

Timeplot
Current RMS value

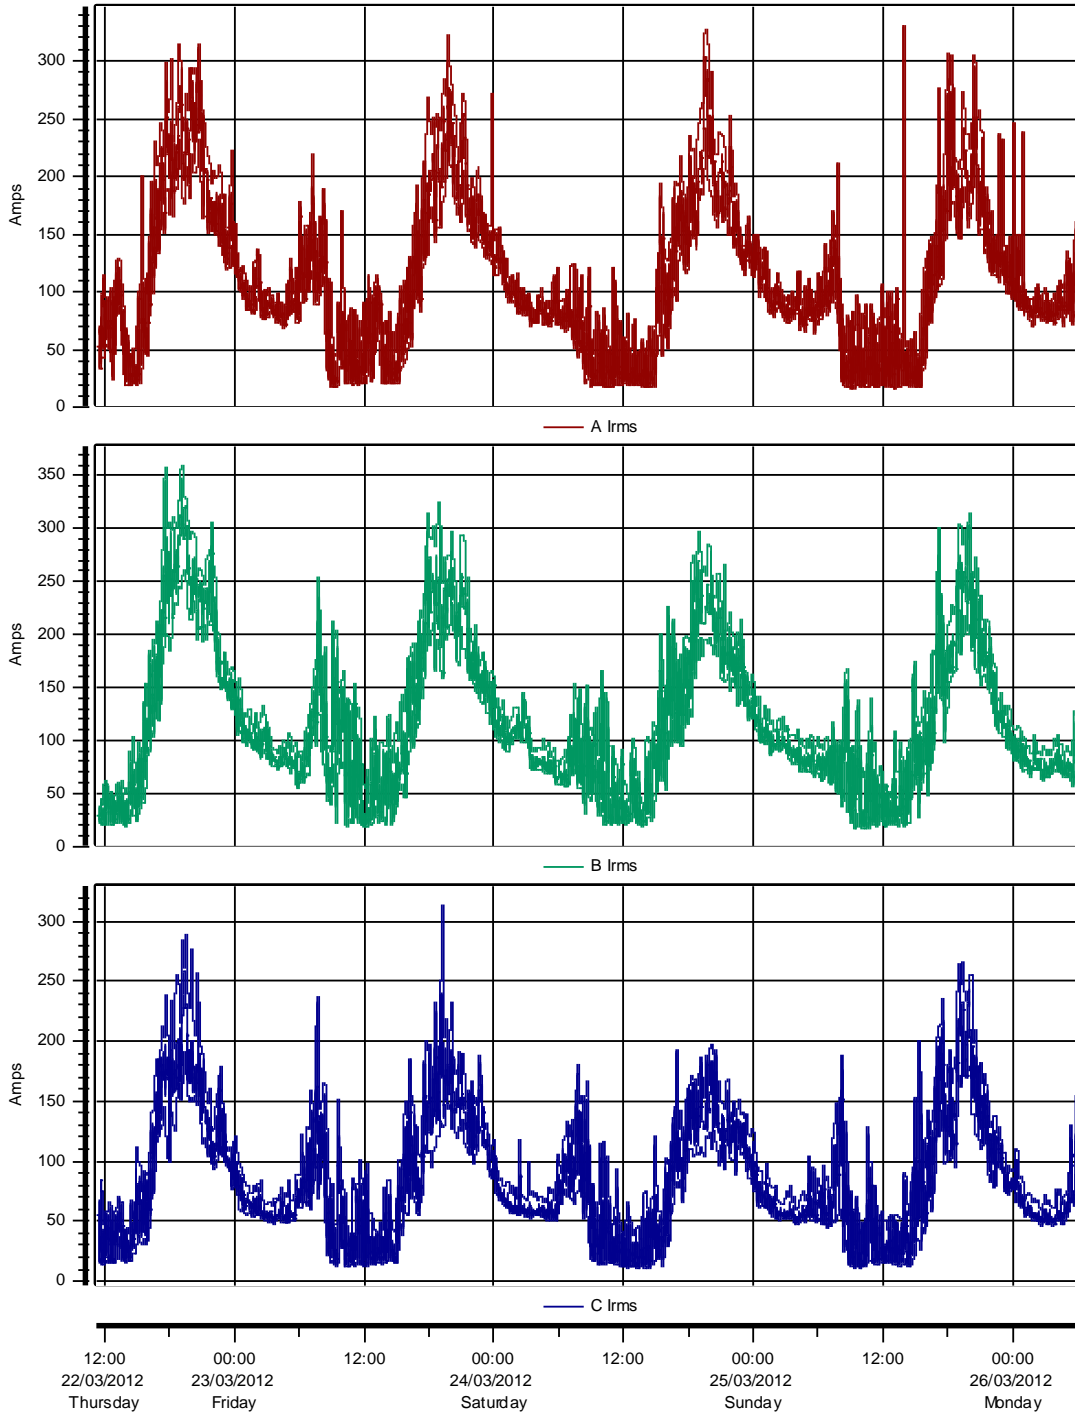


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 13 of 39

Timeplot
Current RMS value

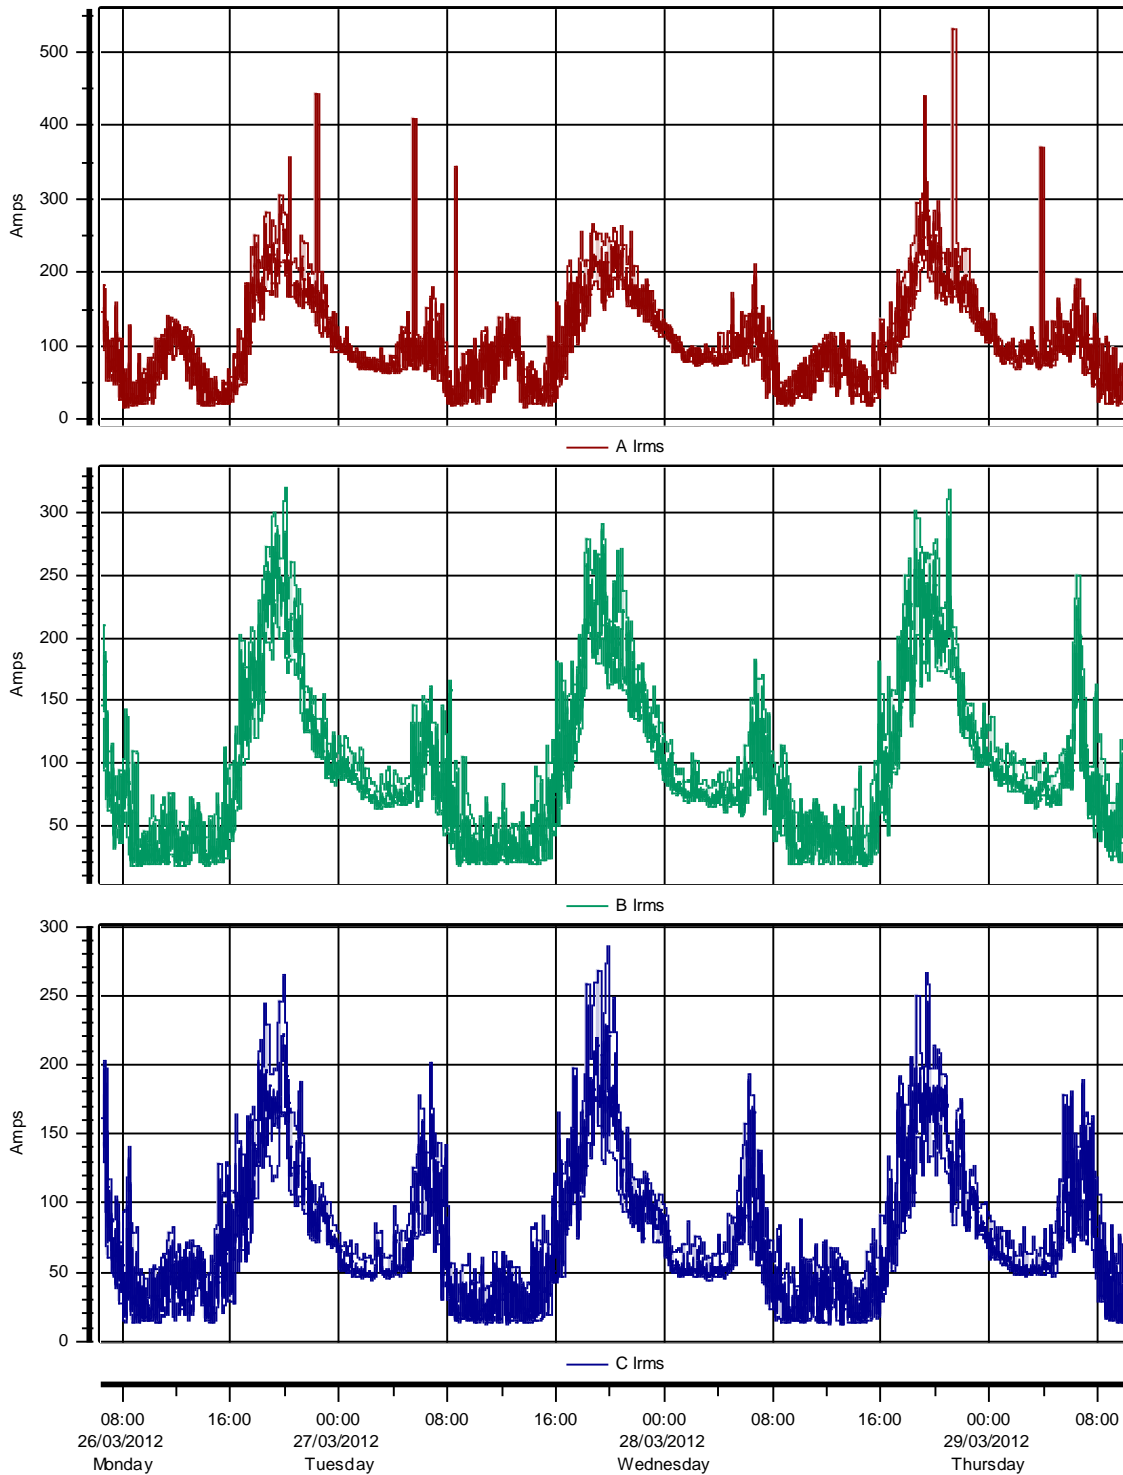


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 14 of 39

Timeplot
Active power, P (W)

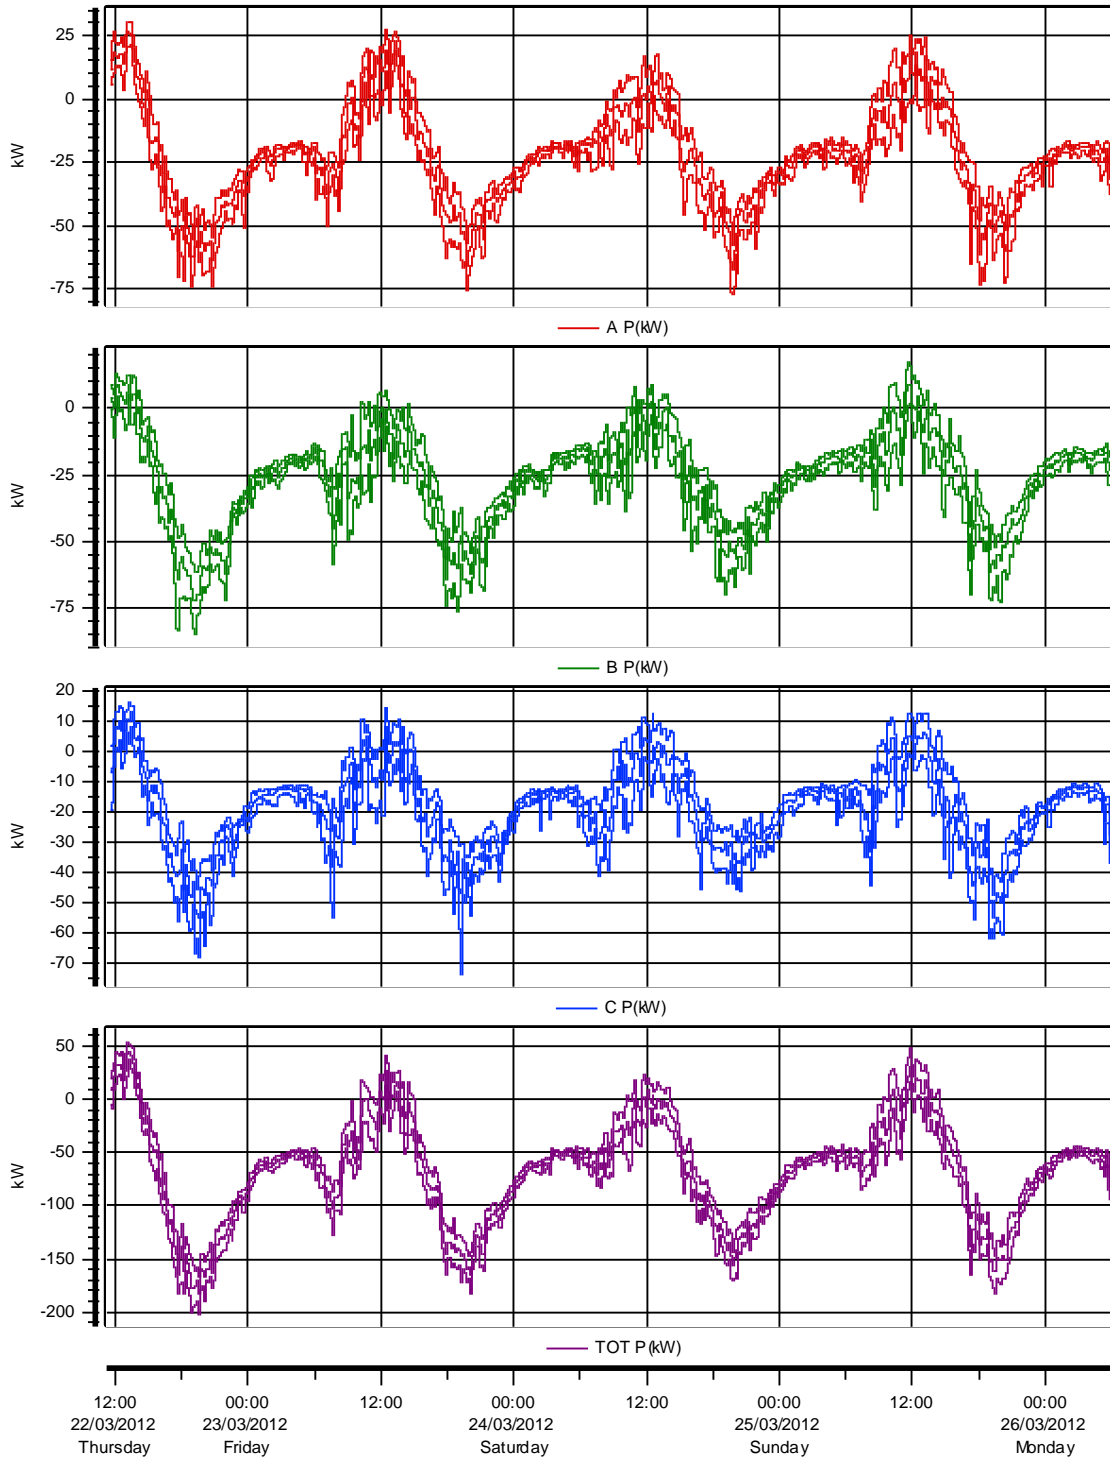


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 15 of 39

Timeplot
Active power, P (W)

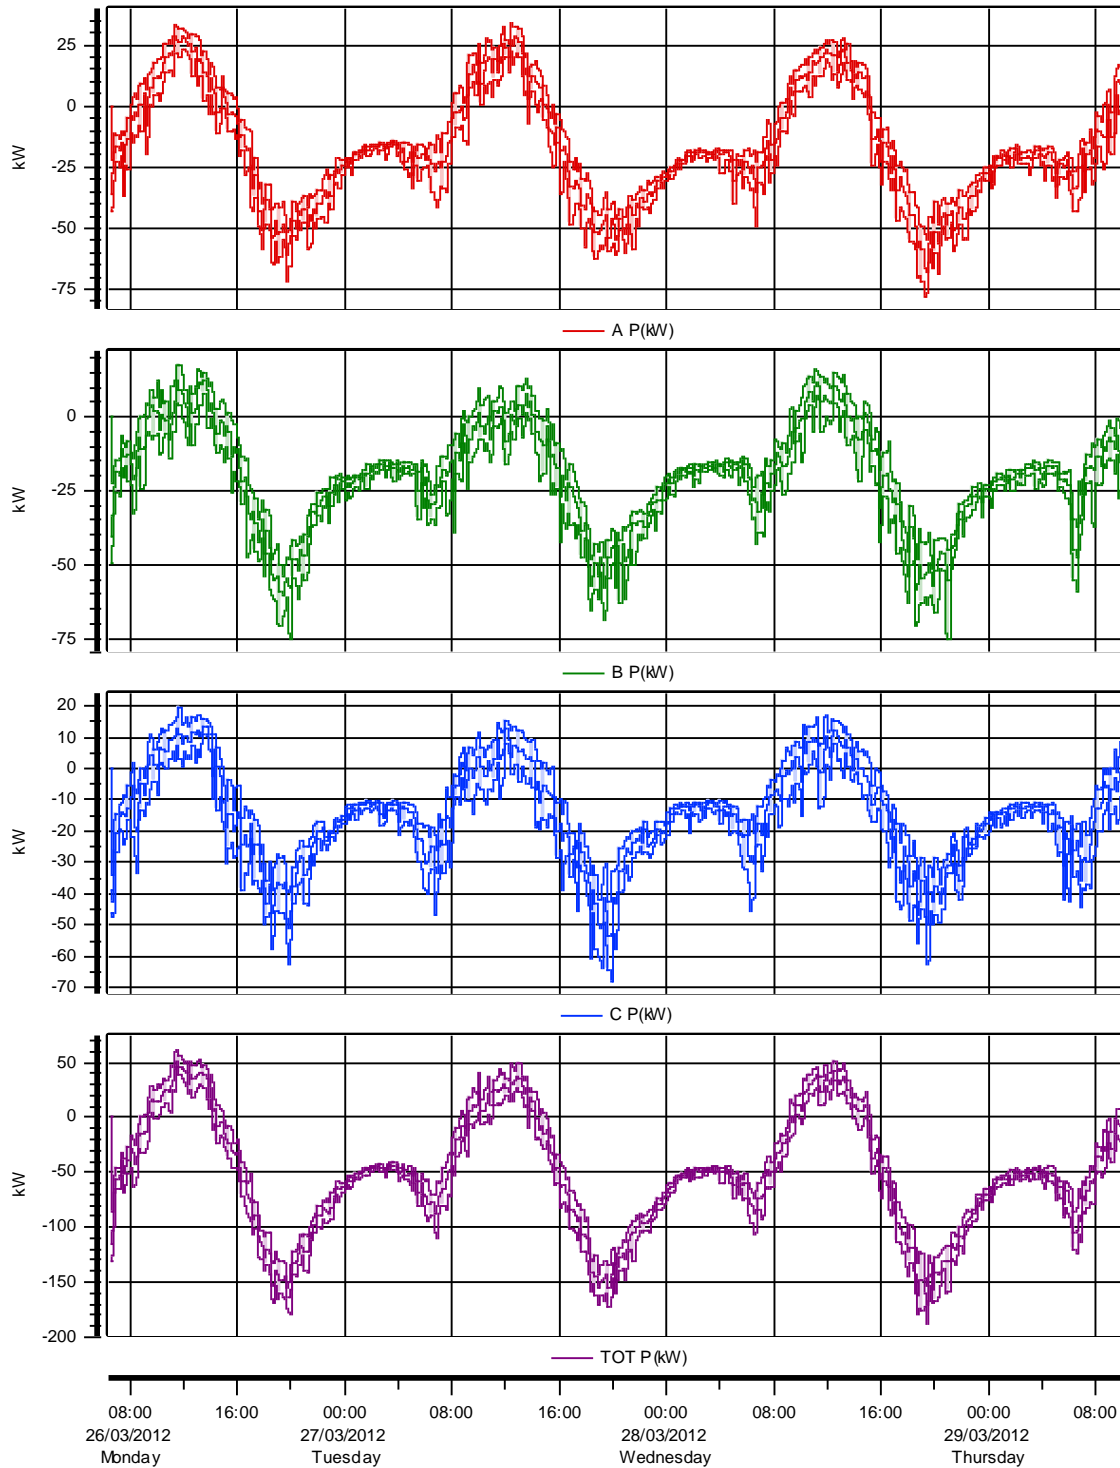


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 16 of 39

Timeplot
Apparent power, S (VA)

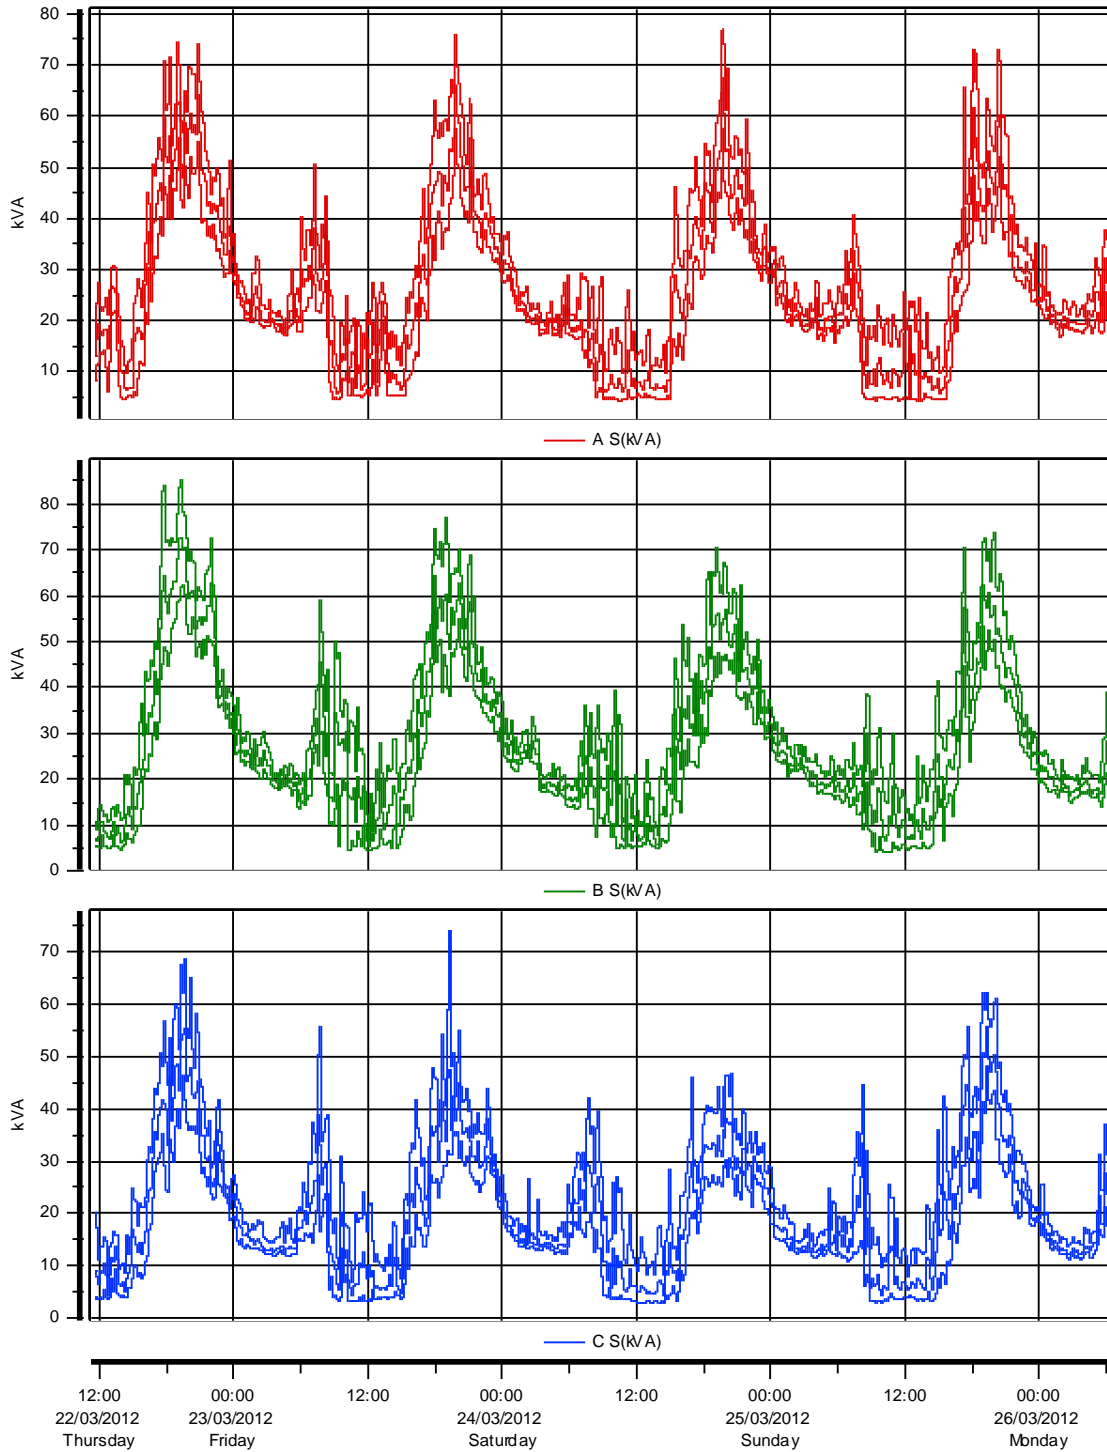


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 17 of 39

Timeplot
Apparent power, S (VA)

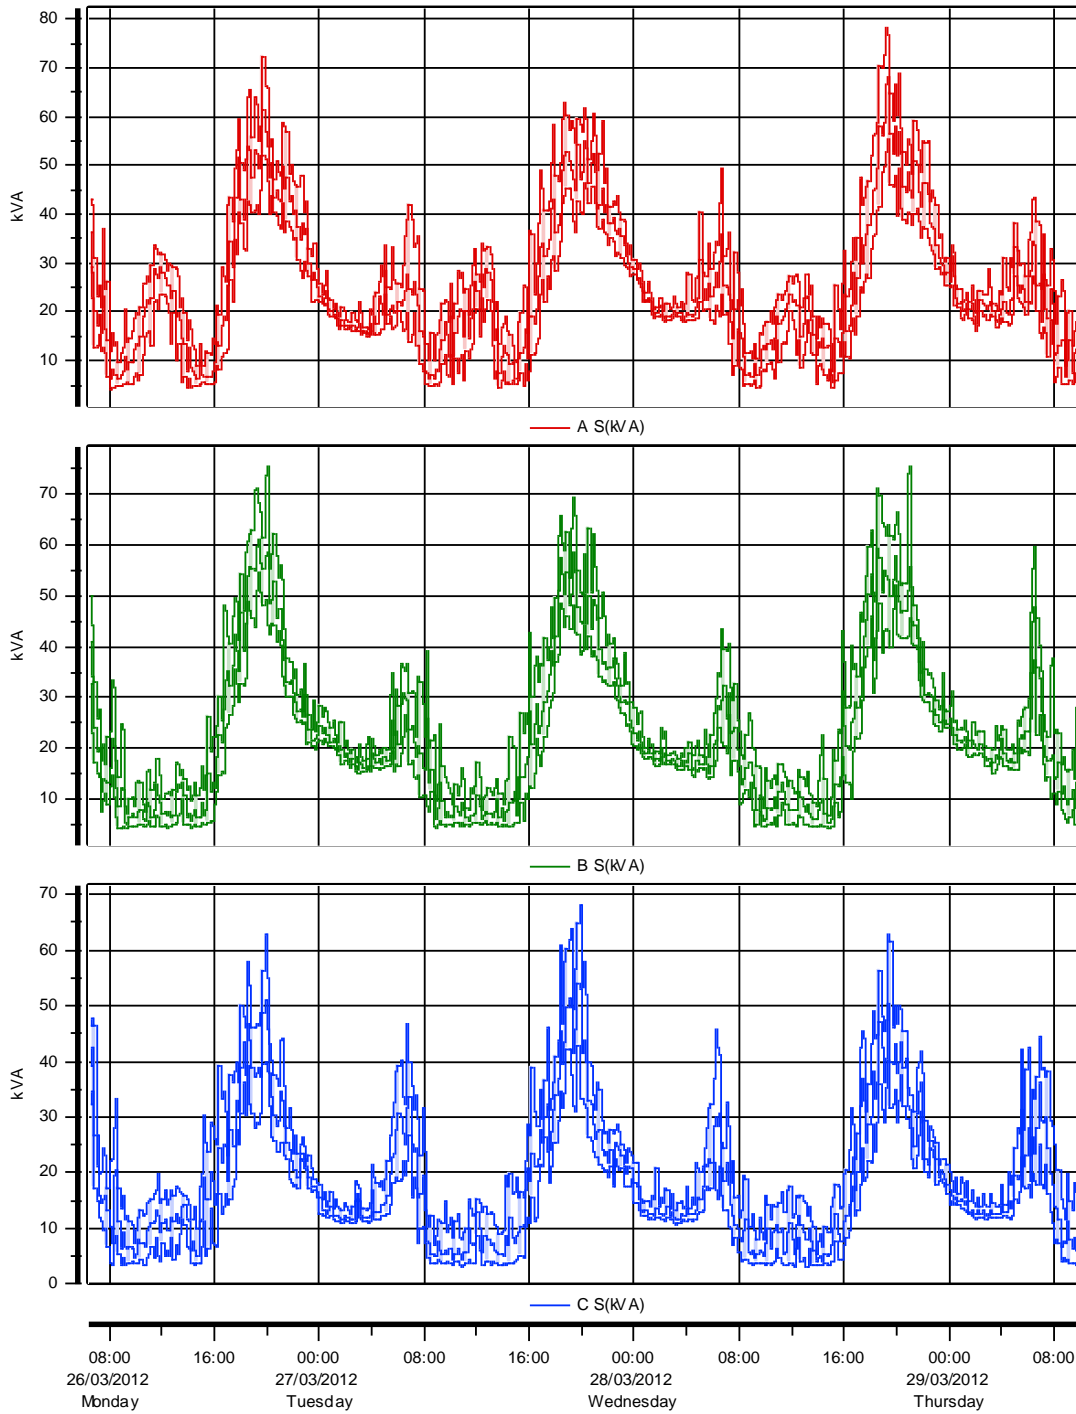


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 18 of 39

Timeplot
Reactive power Q, at fund. freq. (VAR)

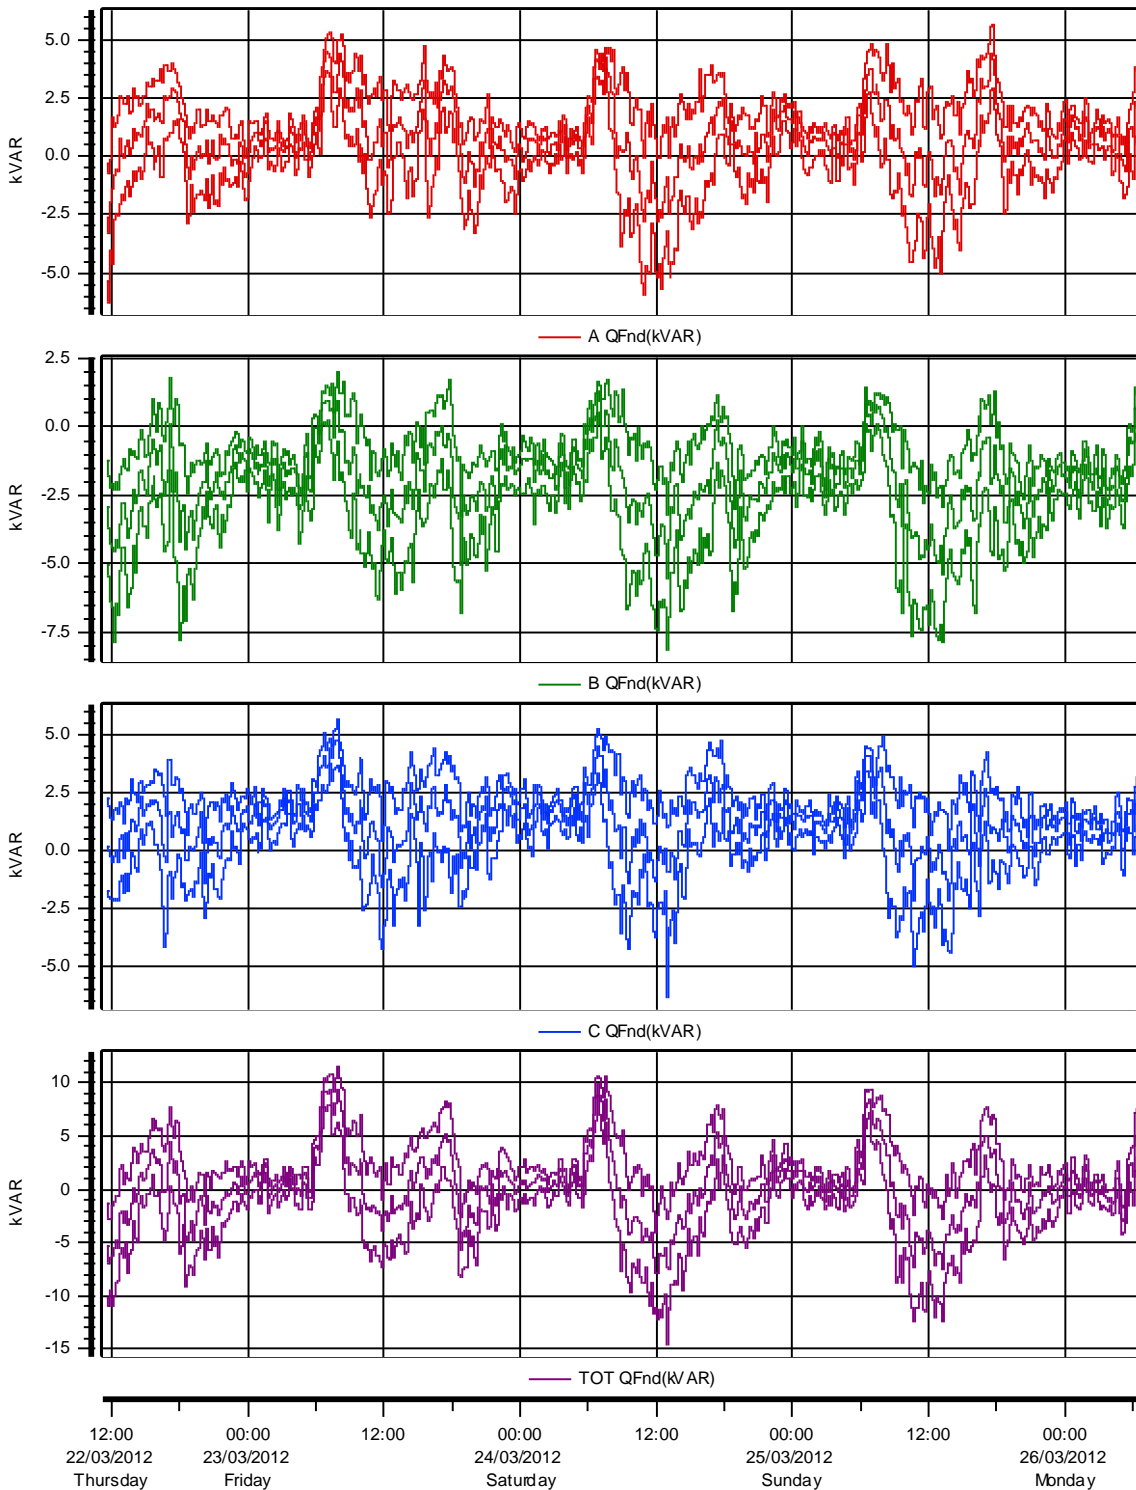


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 19 of 39


Timeplot
Reactive power Q, at fund. freq. (VAR)

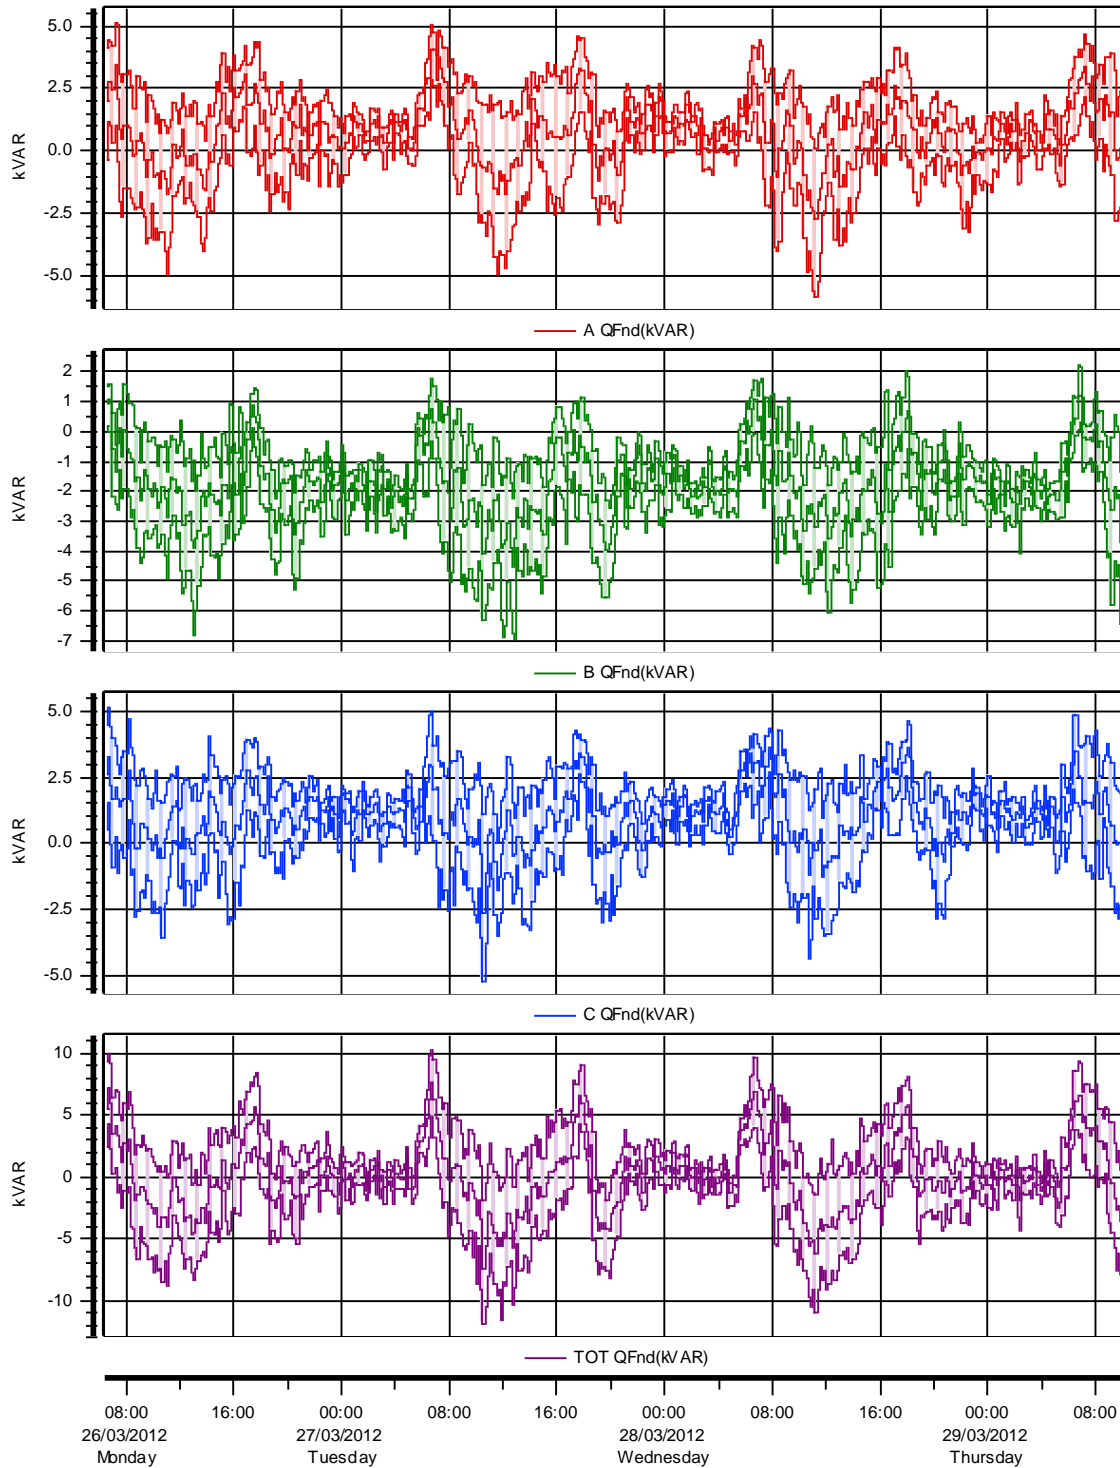


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 20 of 39

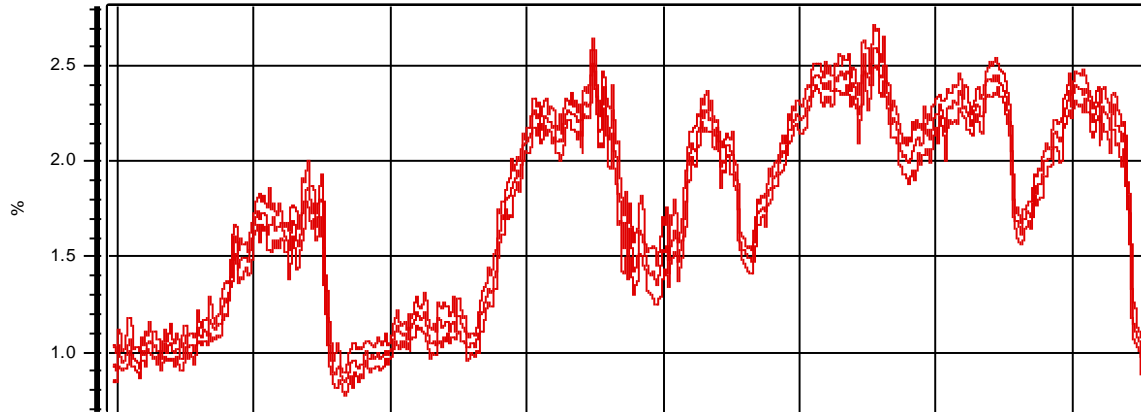

— A VThd

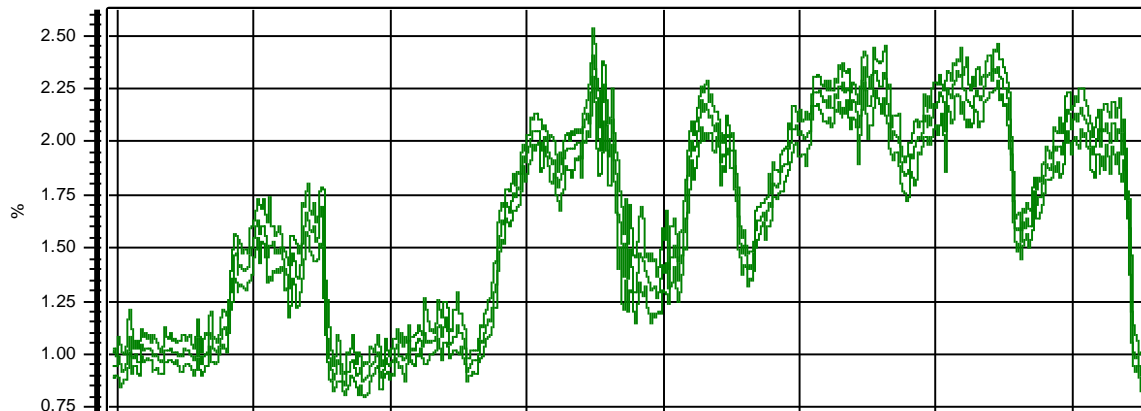


— B VThd

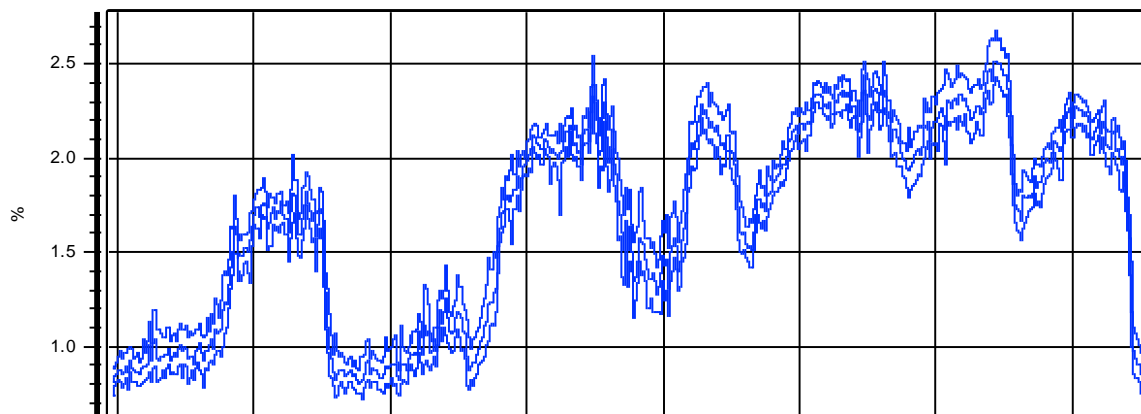


— C VThd

12:00 00:00 12:00 00:00 12:00 00:00 12:00 00:00
 22/03/2012 23/03/2012 24/03/2012 25/03/2012 26/03/2012
 Thursday Friday Saturday Sunday Monday


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 21 of 39

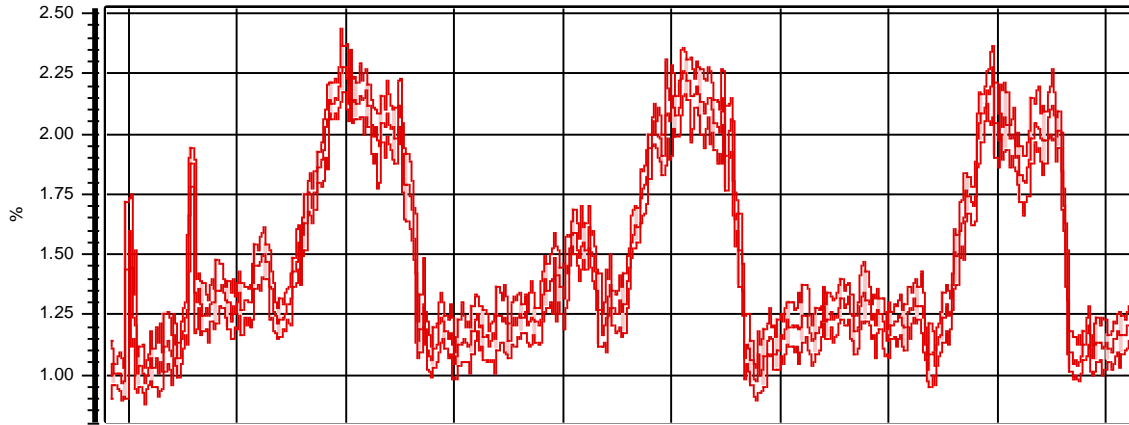

— A VThd

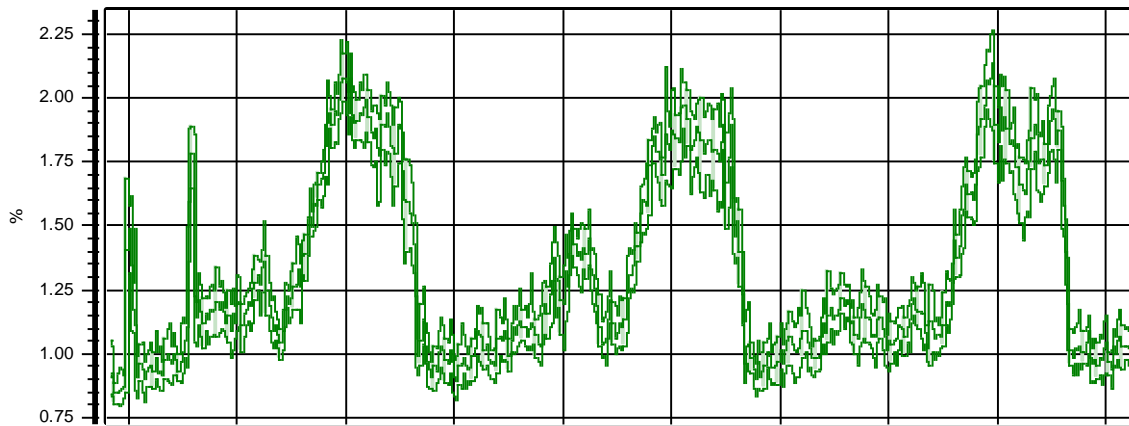

— B VThd

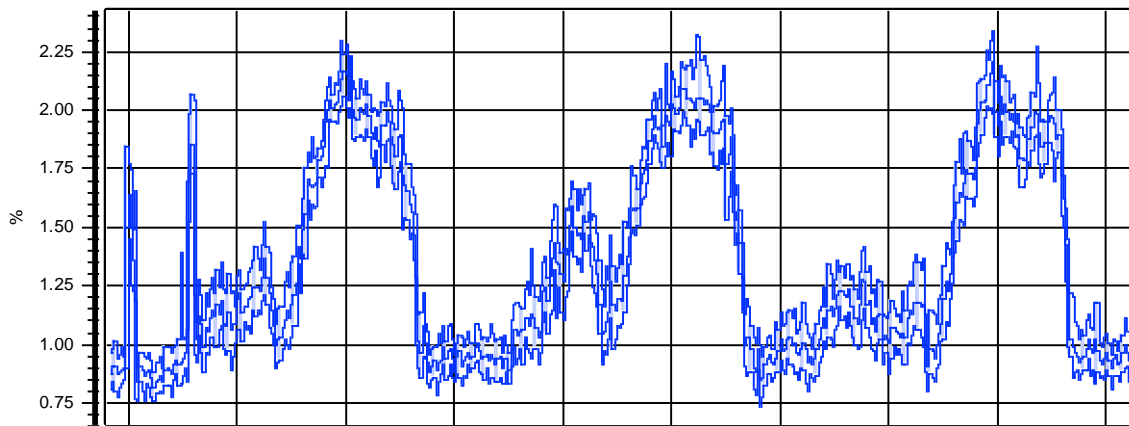


— C VThd

08:00 16:00 00:00 08:00 16:00 00:00 08:00 16:00 00:00 08:00
 26/03/2012 27/03/2012 28/03/2012 29/03/2012
 Monday Tuesday Wednesday Thursday


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 22 of 39

Timeplot
Voltage Spectra

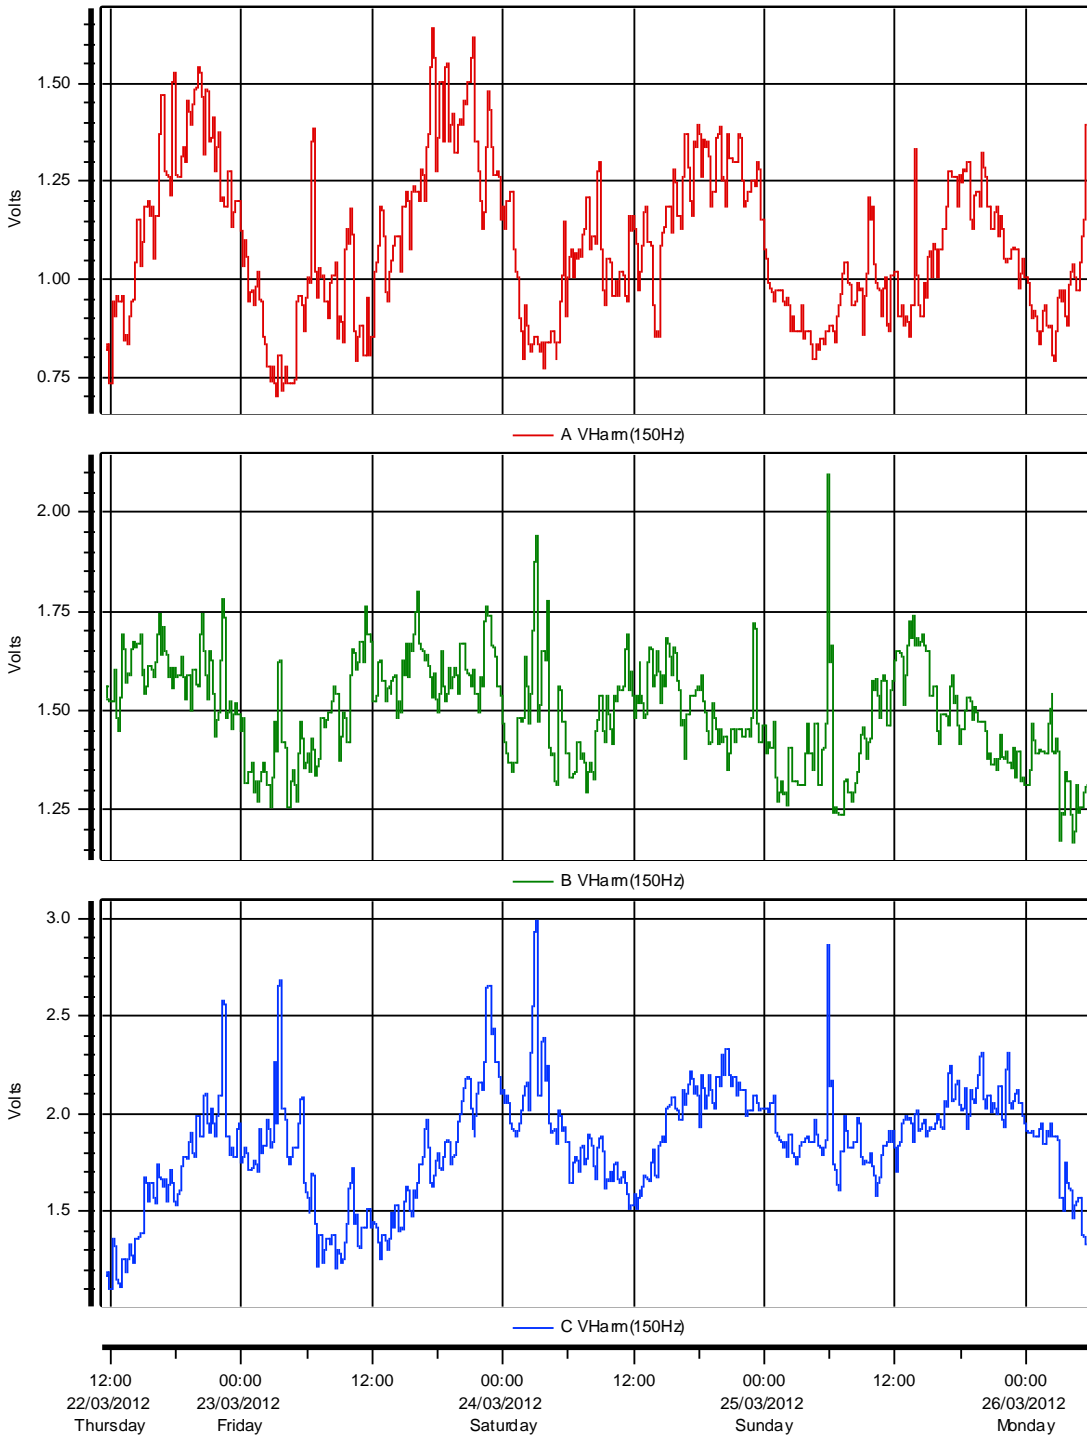


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 23 of 39


Timeplot
Voltage Spectra

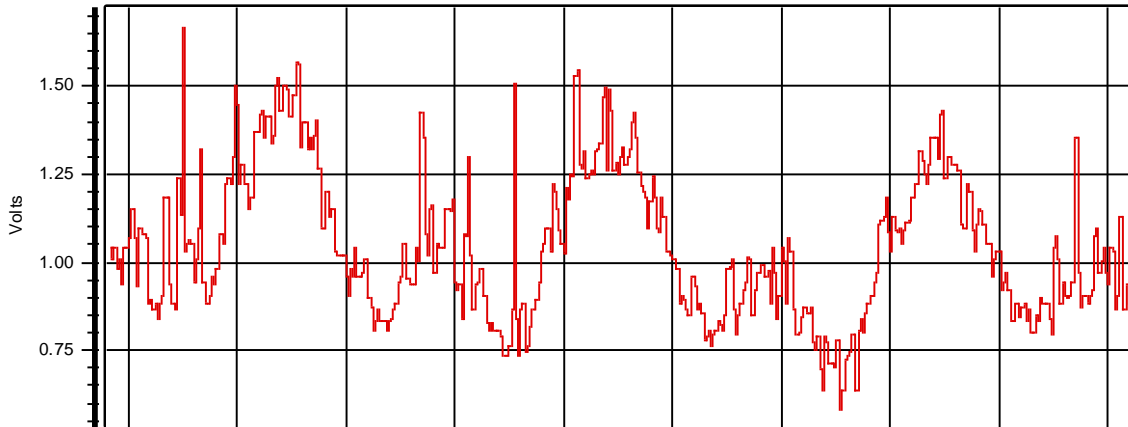

— A VHam(150Hz)

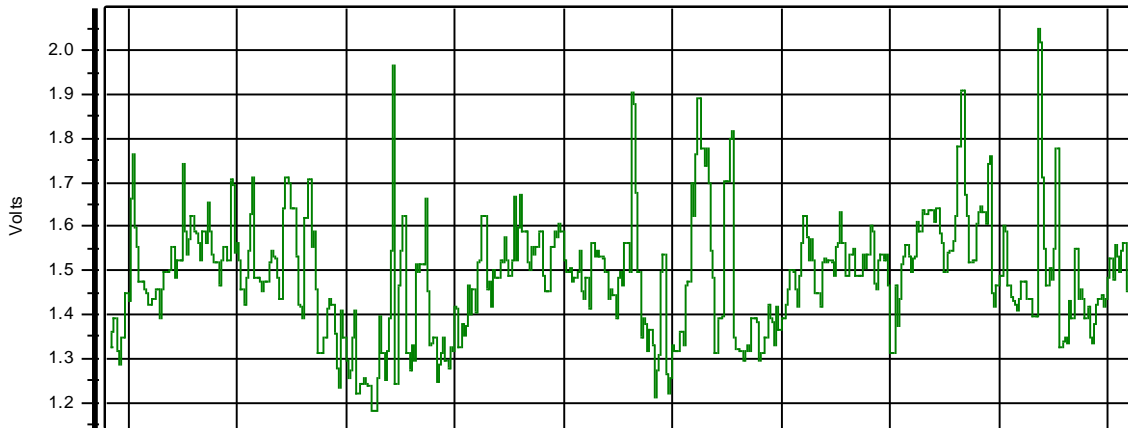

— B VHam(150Hz)

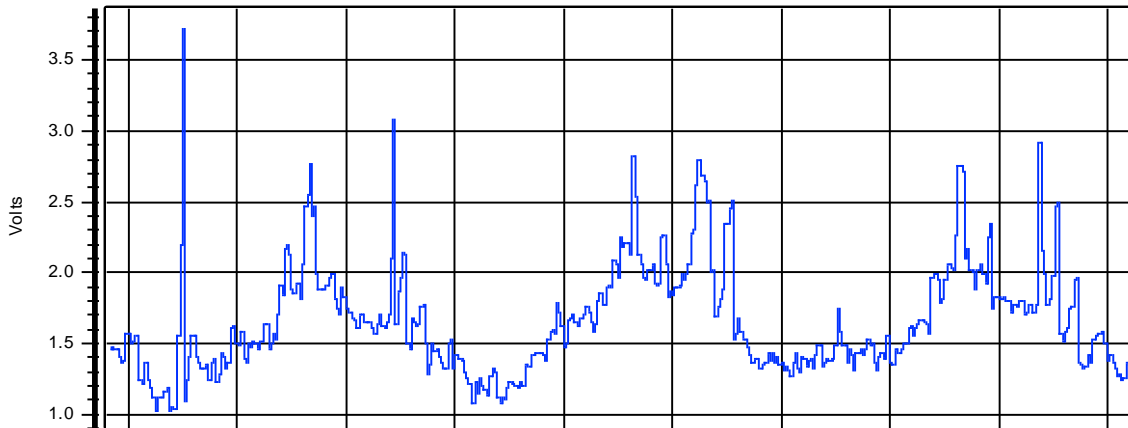


— C VHam(150Hz)

08:00 16:00 00:00 08:00 16:00 00:00 08:00 16:00 00:00 08:00
26/03/2012 27/03/2012 28/03/2012 29/03/2012
Monday Tuesday Wednesday Thursday


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 24 of 39

Timeplot
Voltage Spectra

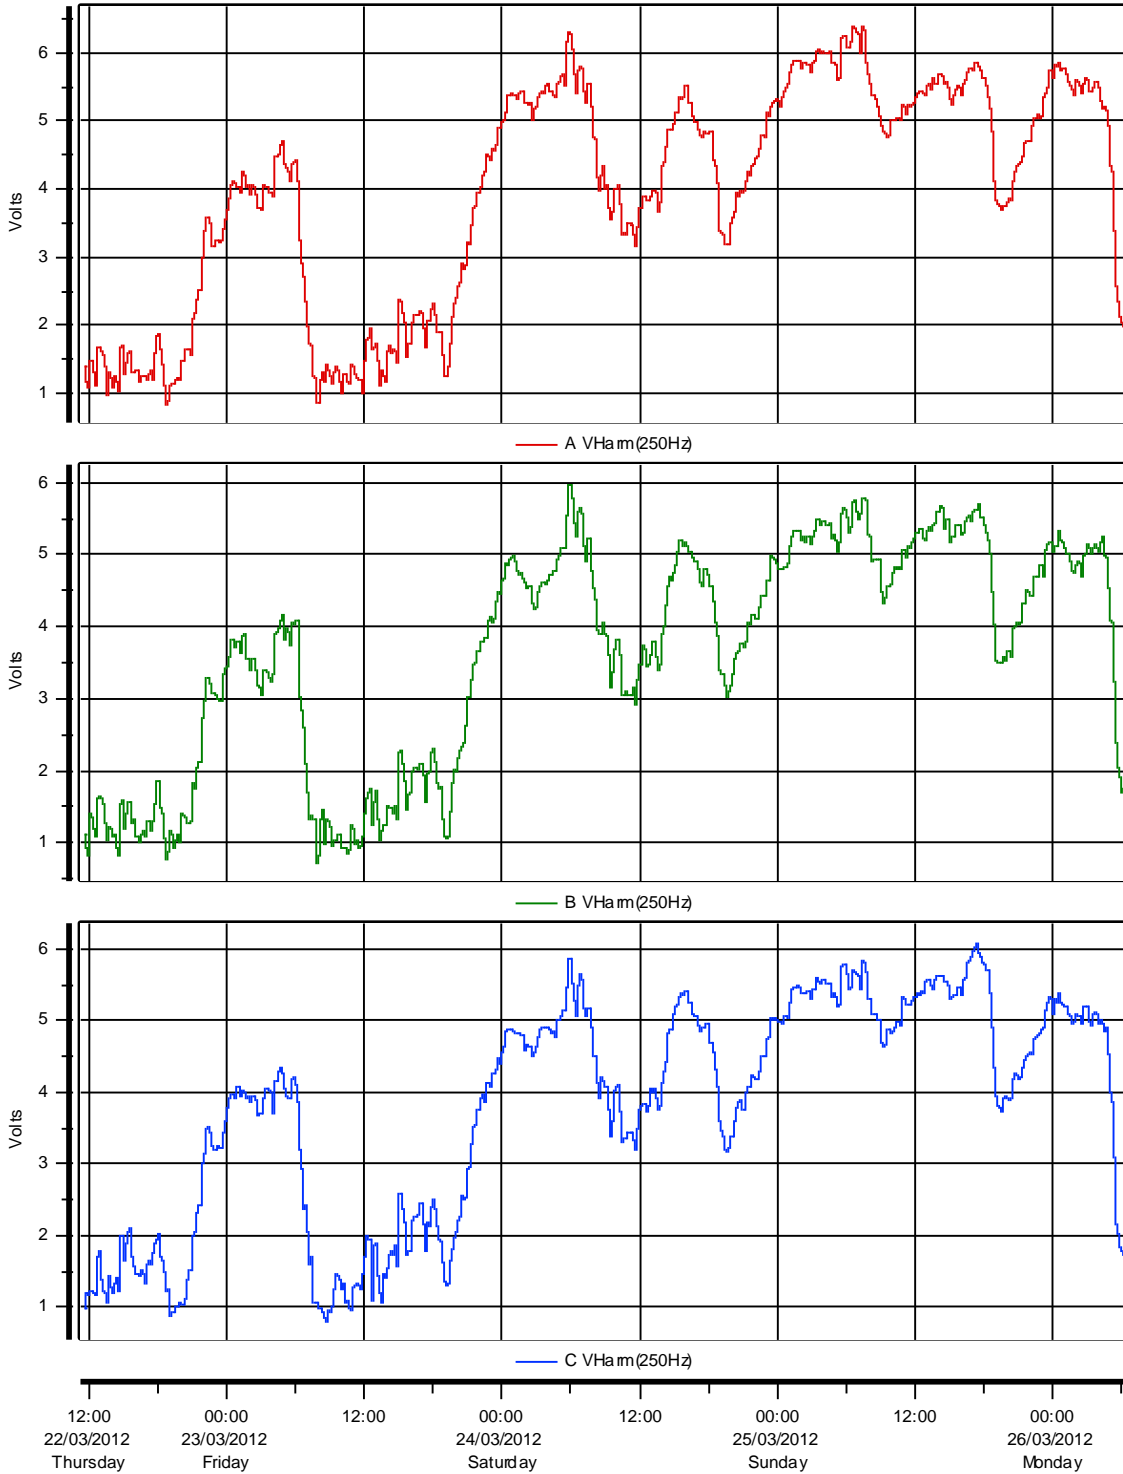


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 25 of 39

Timeplot
Voltage Spectra

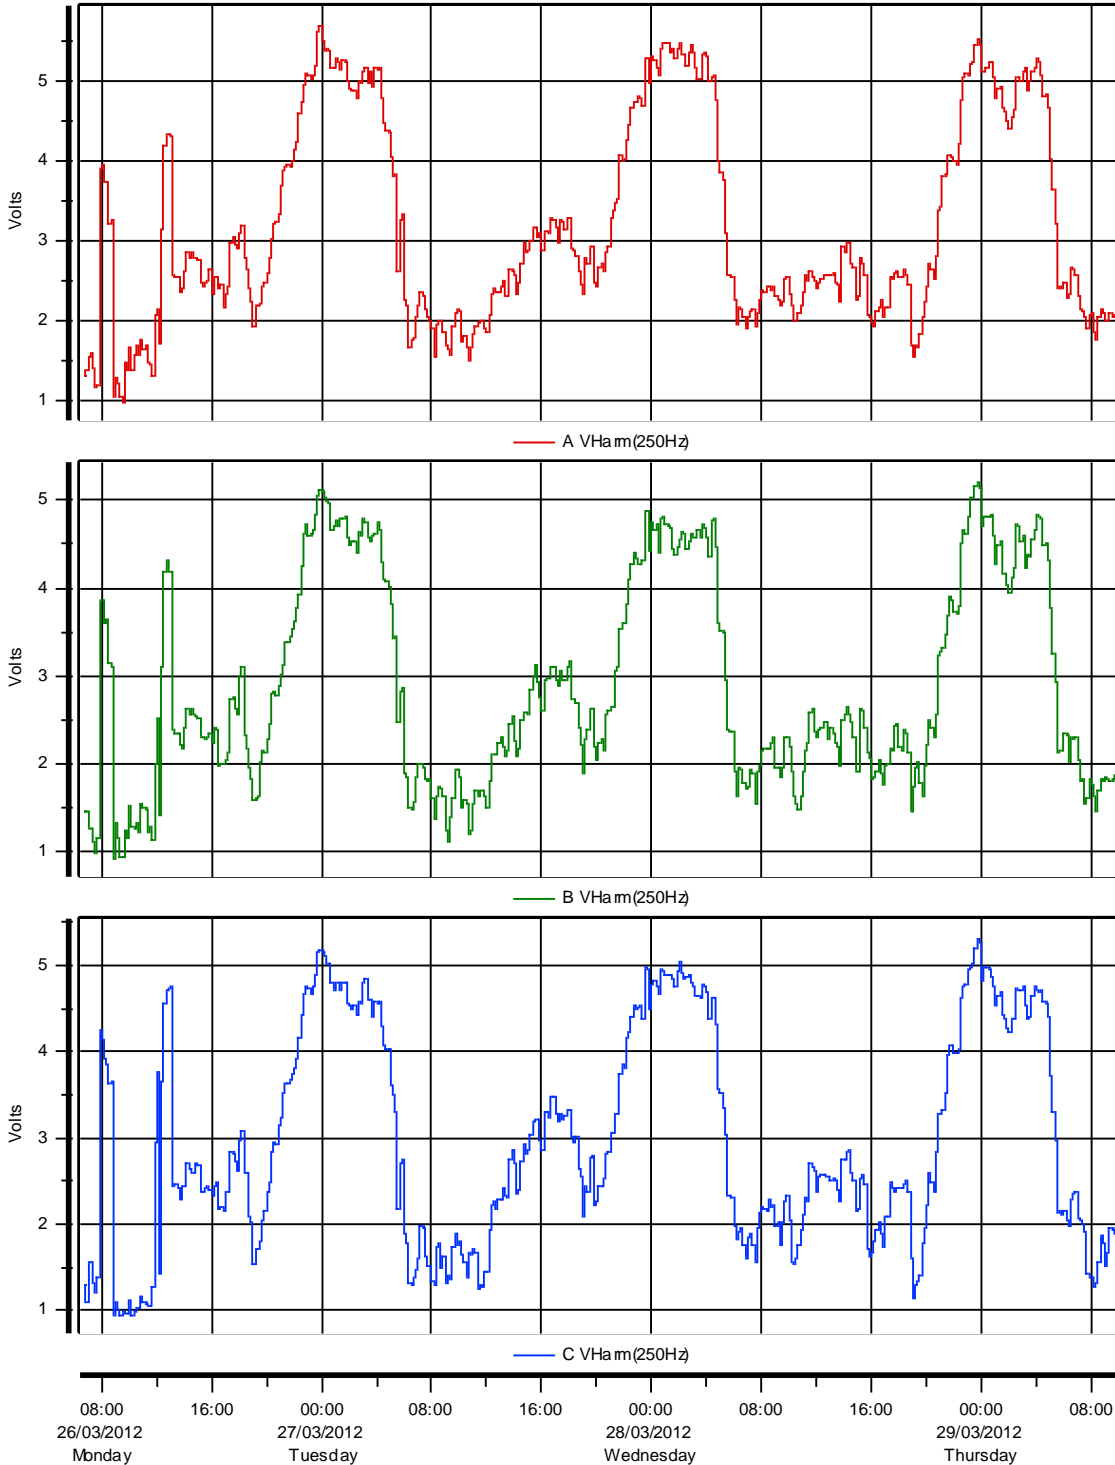


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 26 of 39


Timeplot
Voltage Spectra

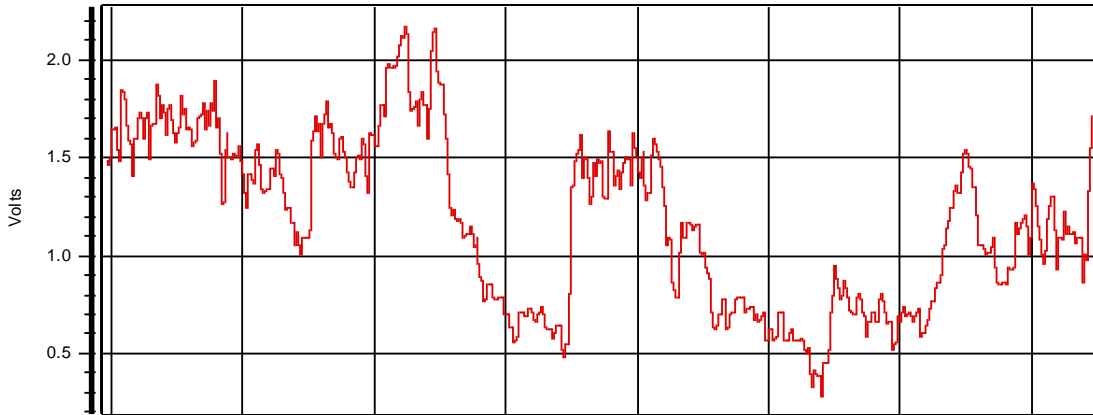

A VHar(350Hz)

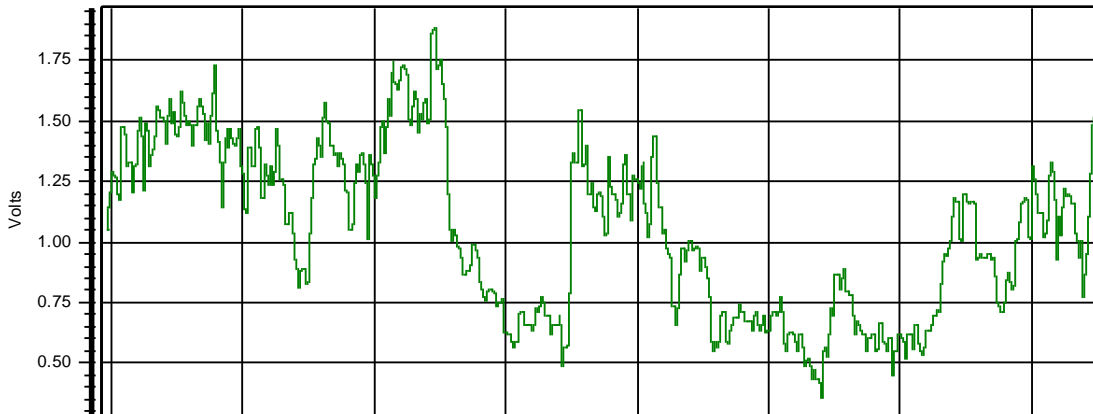

B VHar(350Hz)

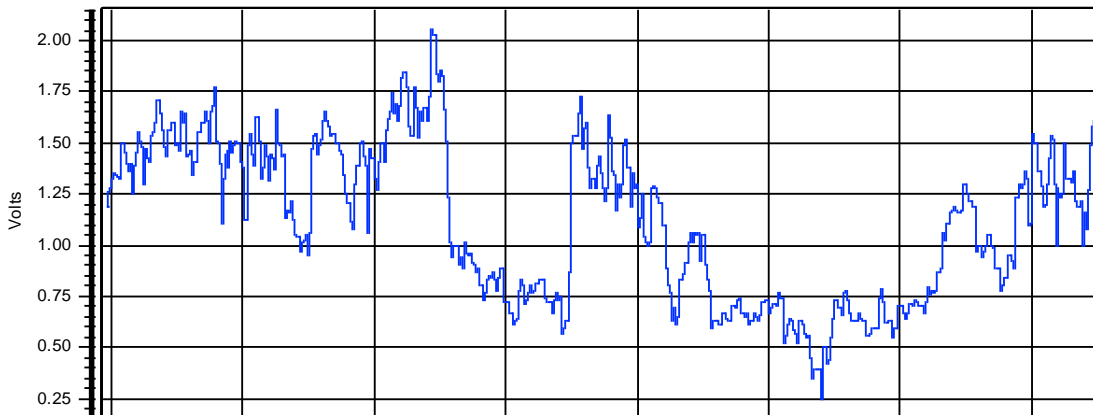


C VHar(350Hz)

12:00 00:00 12:00 00:00 12:00 00:00 12:00 00:00
 22/03/2012 23/03/2012 24/03/2012 25/03/2012 26/03/2012
 Thursday Friday Saturday Sunday Monday


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 27 of 39

Timeplot
Voltage Spectra

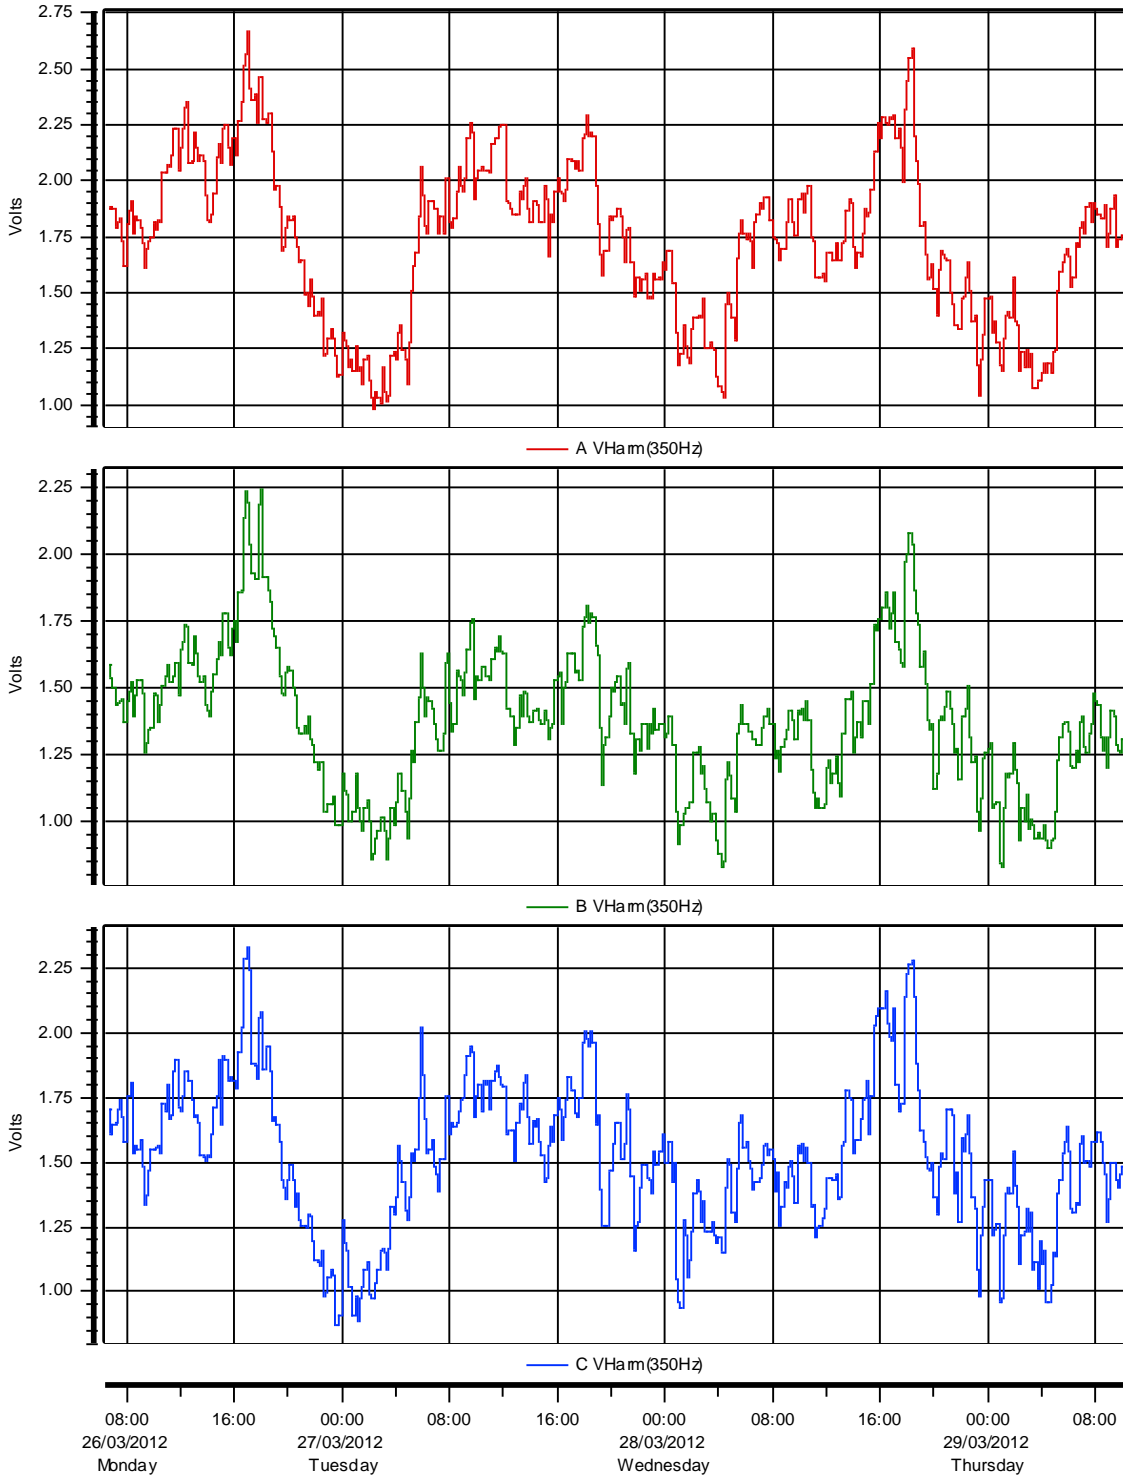




<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 28 of 39

Timeplot
Voltage Spectra

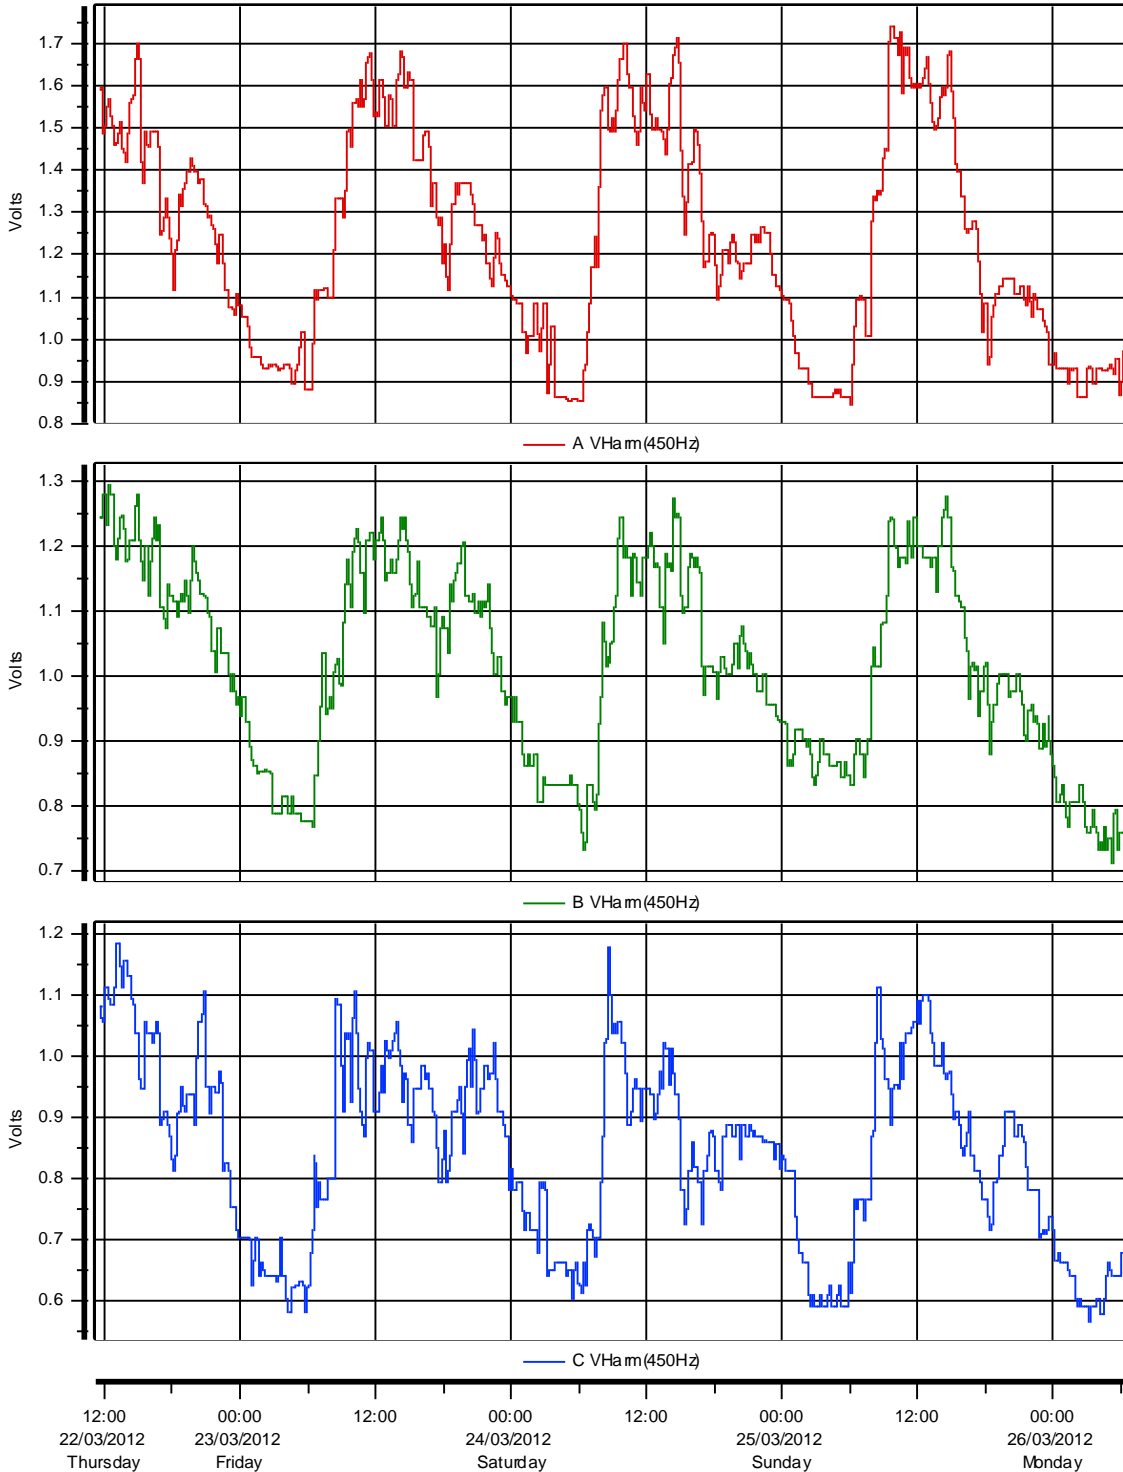

<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 29 of 39




Timeplot
Voltage Spectra

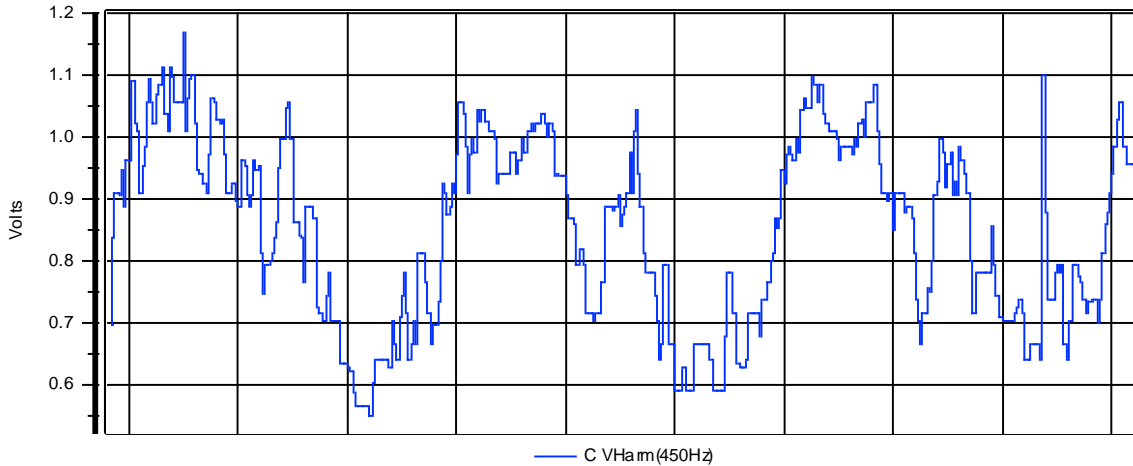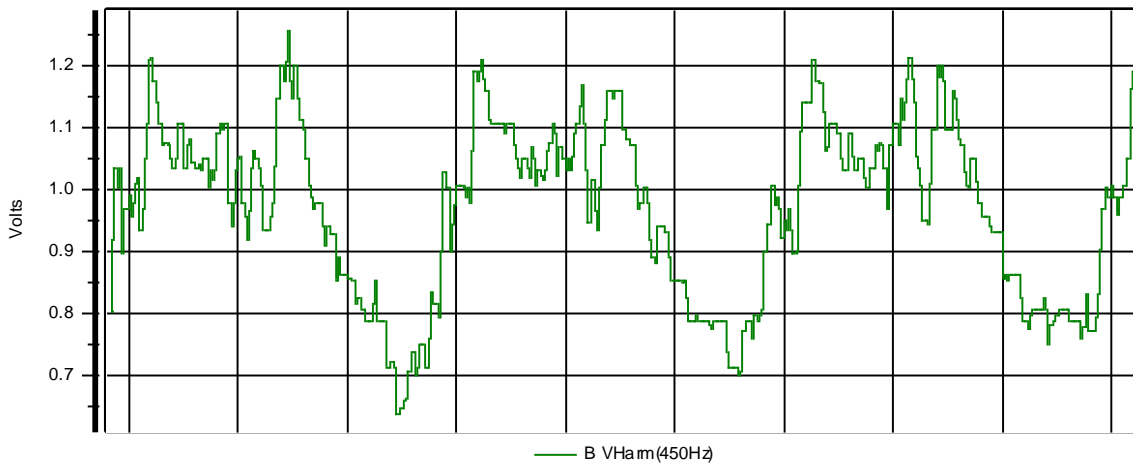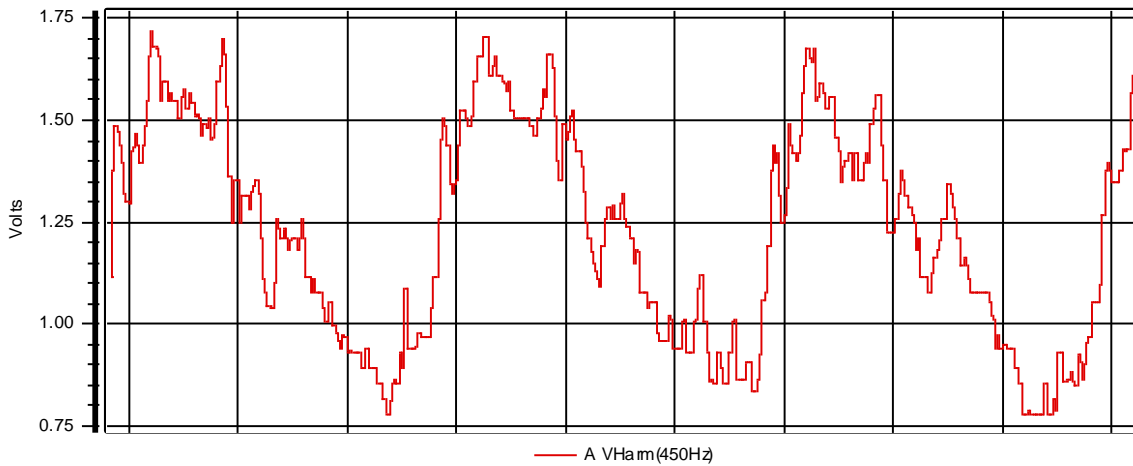

08:00 16:00 00:00 08:00 16:00 00:00 08:00 16:00 00:00 08:00
26/03/2012 27/03/2012 28/03/2012 29/03/2012
Monday Tuesday Wednesday Thursday


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 30 of 39

Timeplot
Current Spectra

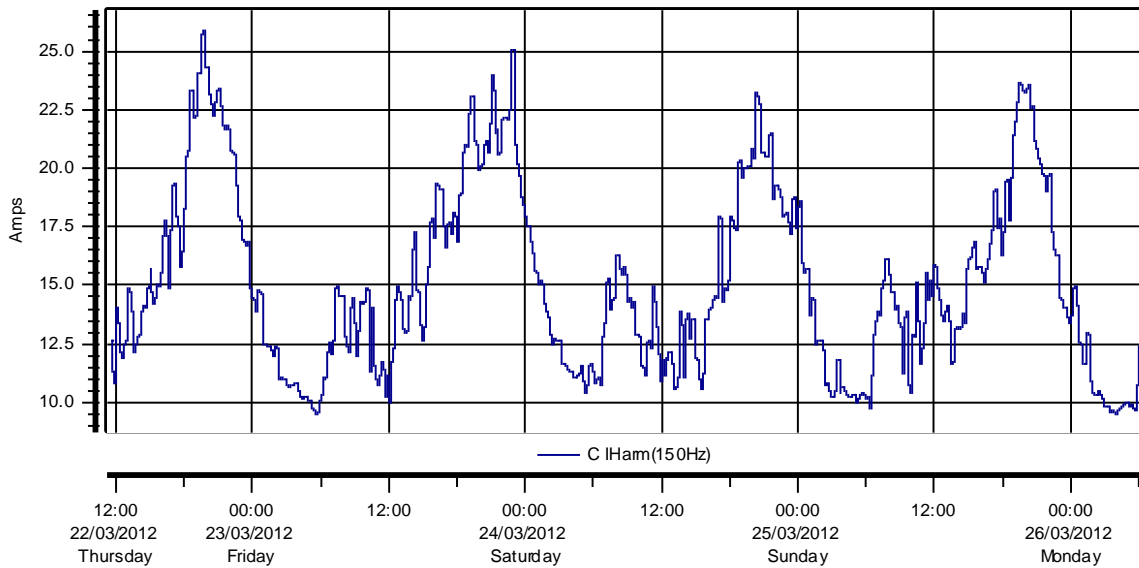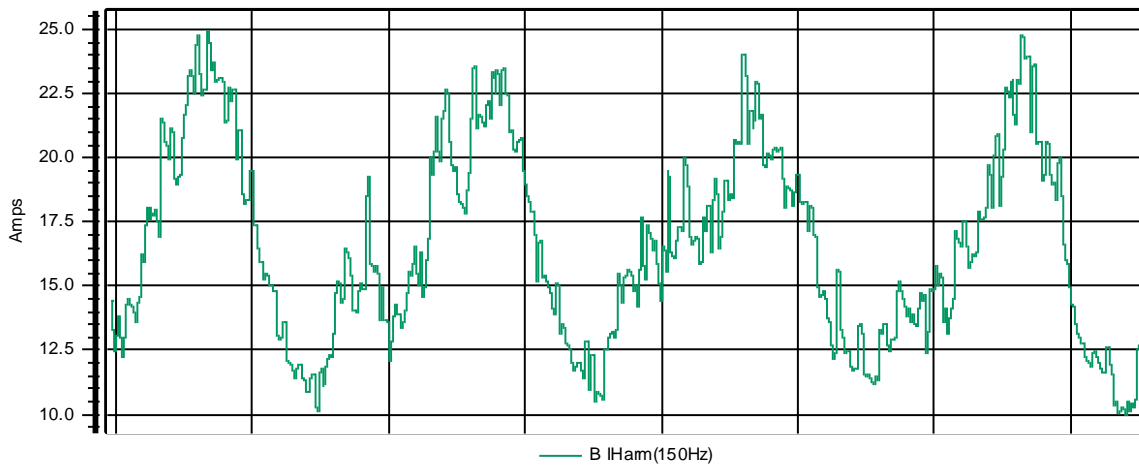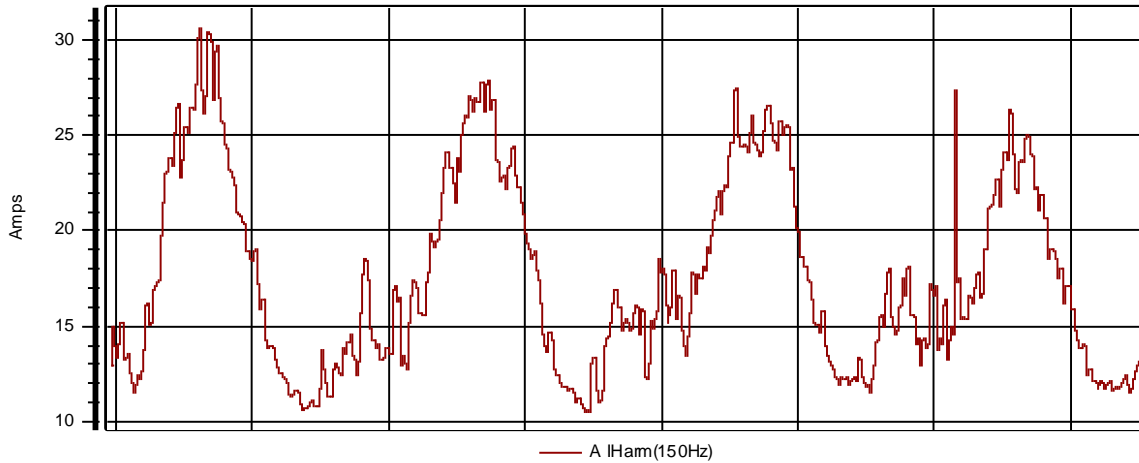


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 31 of 39


Timeplot
Current Spectra

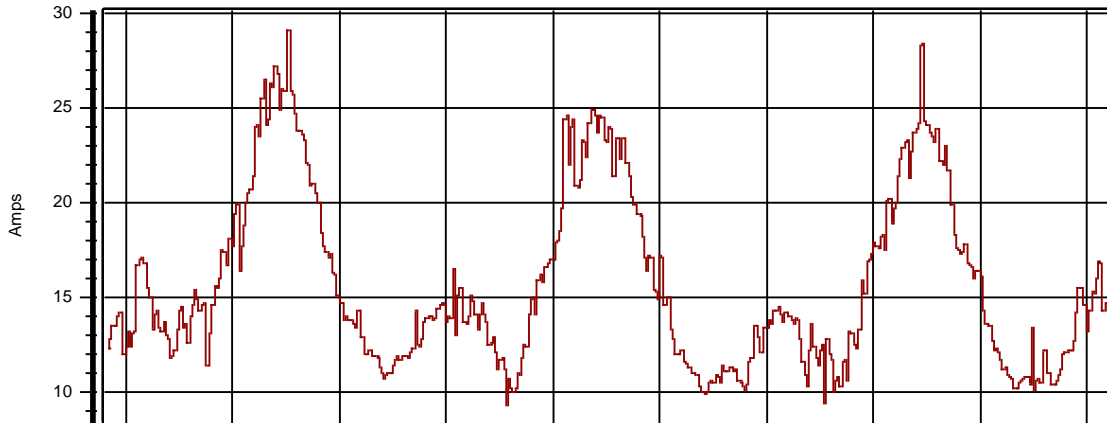

— A IHam(150Hz)

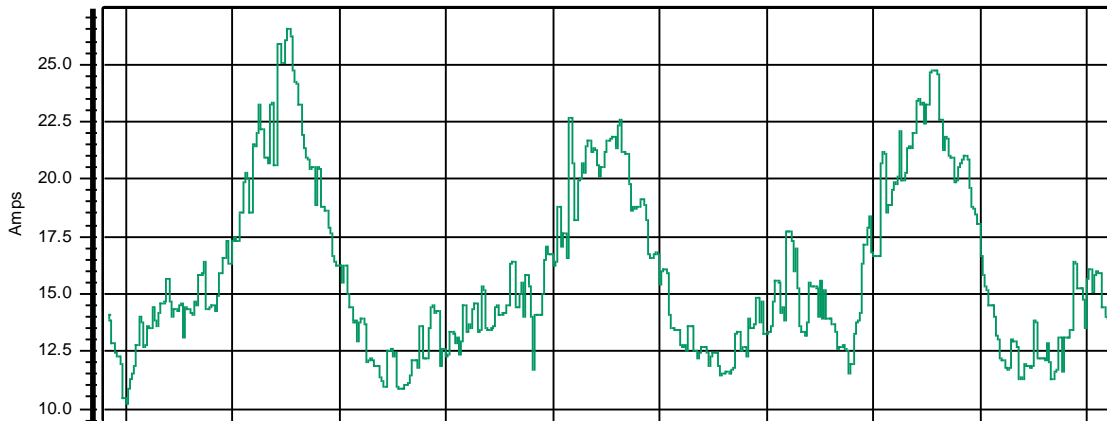

— B IHam(150Hz)

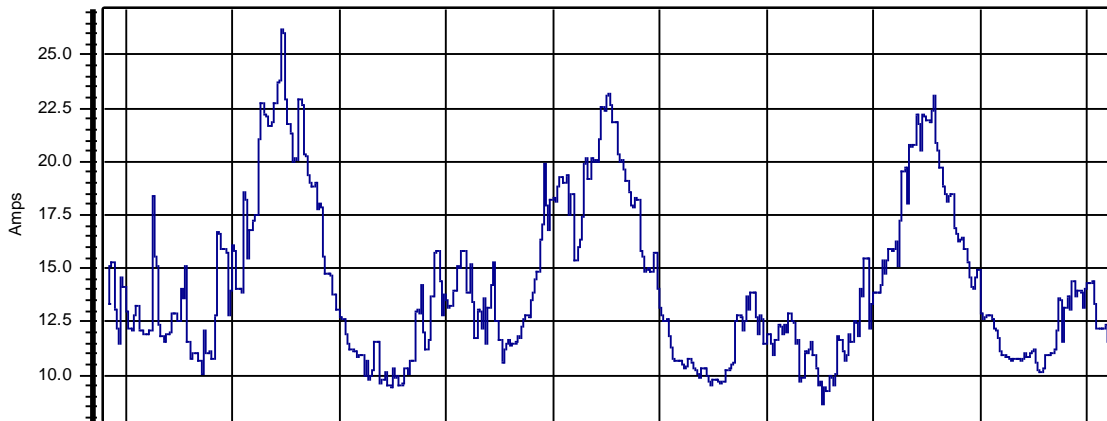


— C IHam(150Hz)

08:00 16:00 00:00 08:00 16:00 00:00 08:00 16:00 00:00 08:00
 26/03/2012 27/03/2012 28/03/2012 29/03/2012
 Monday Tuesday Wednesday Thursday


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 32 of 39

Timeplot
Current Spectra

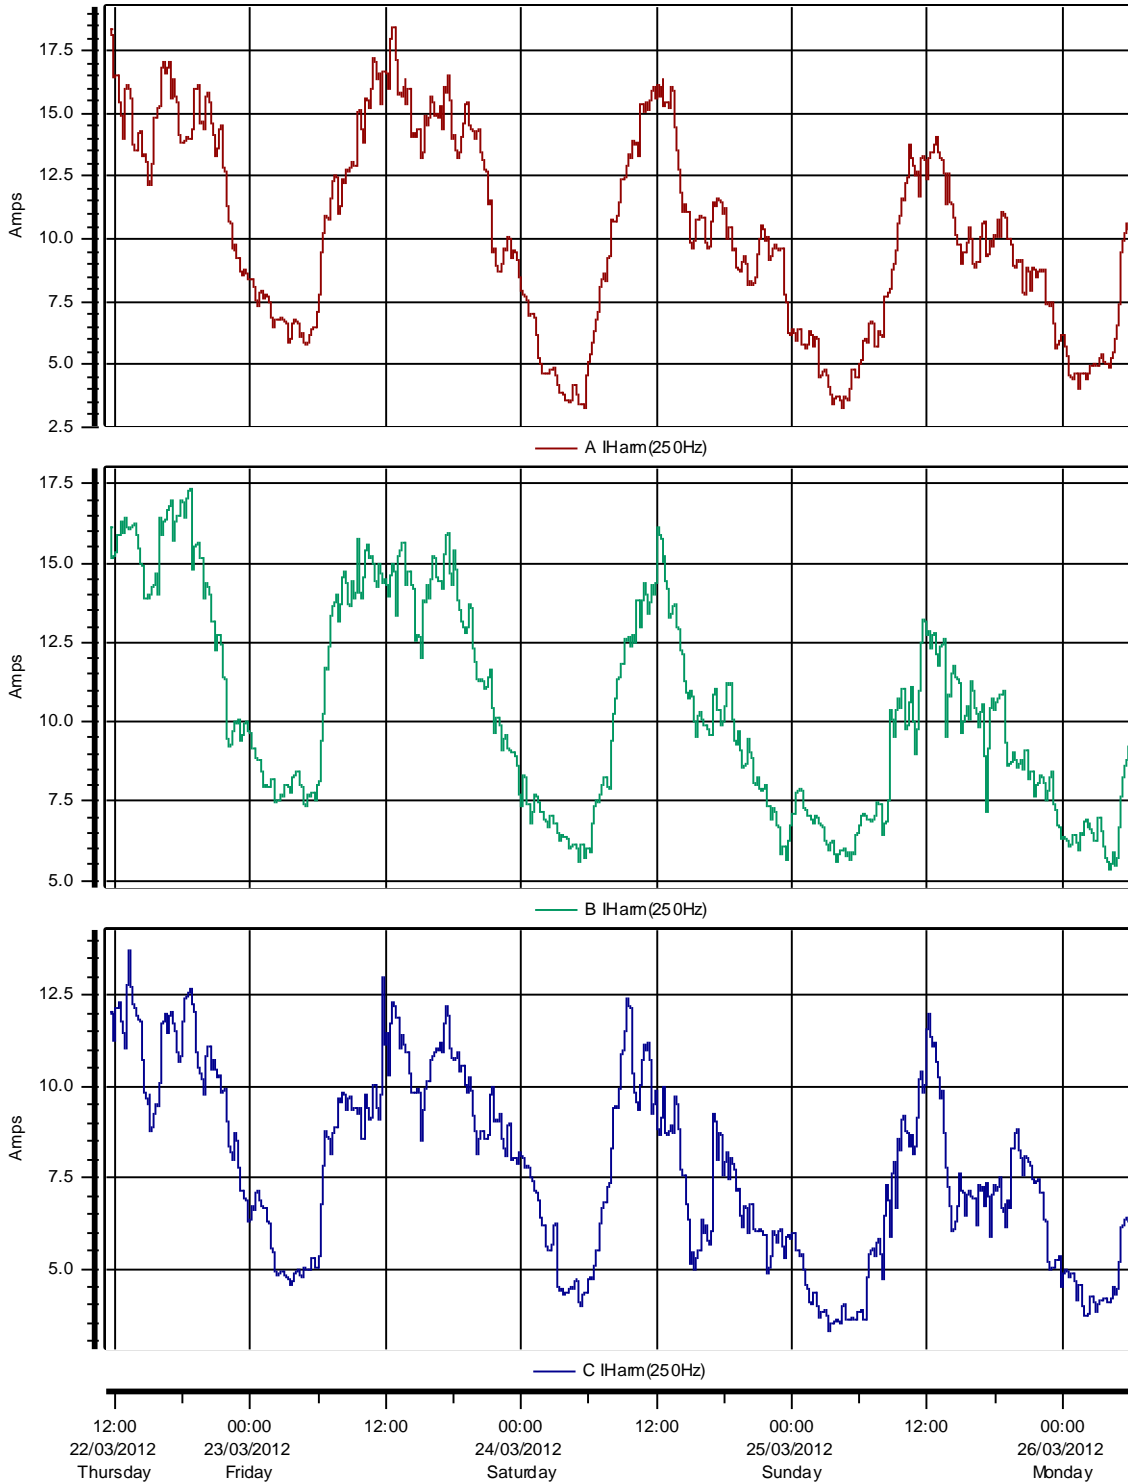


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 33 of 39


Timeplot
Current Spectra

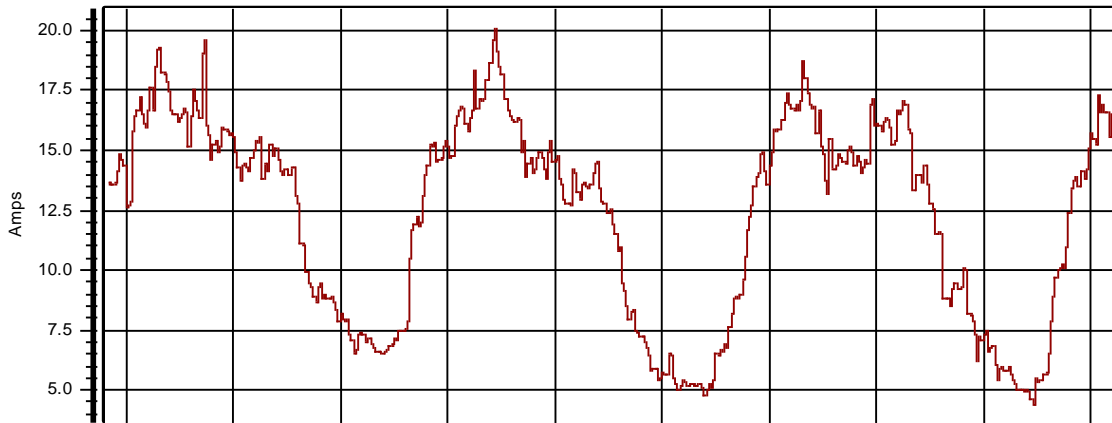

— A IHam(250Hz)

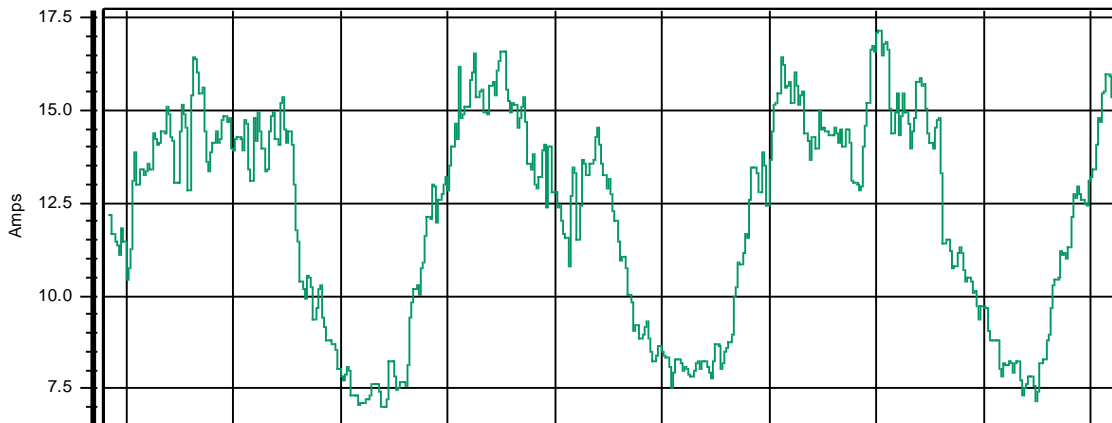

— B IHam(250Hz)

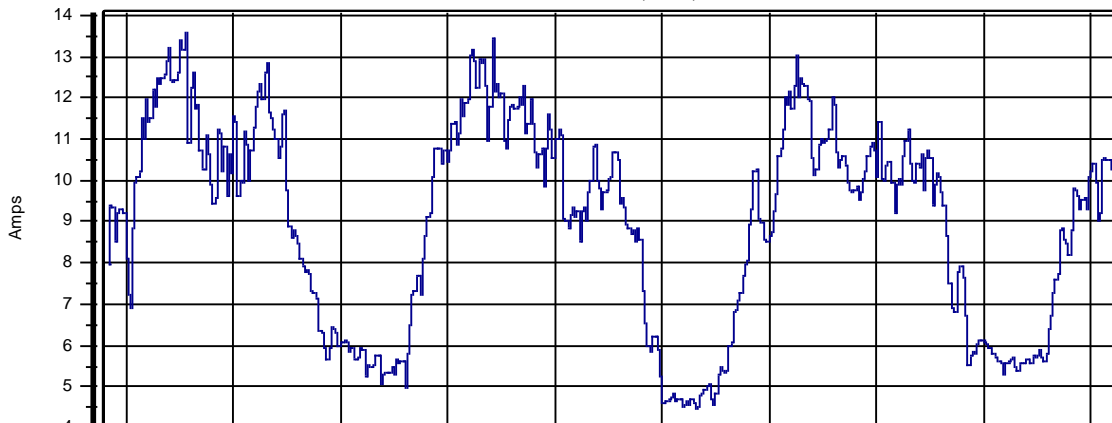


— C IHam(250Hz)

08:00 16:00 00:00 08:00 16:00 00:00 08:00 16:00 00:00 08:00
 26/03/2012 27/03/2012 28/03/2012 29/03/2012
 Monday Tuesday Wednesday Thursday


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 34 of 39

Timeplot
Current Spectra

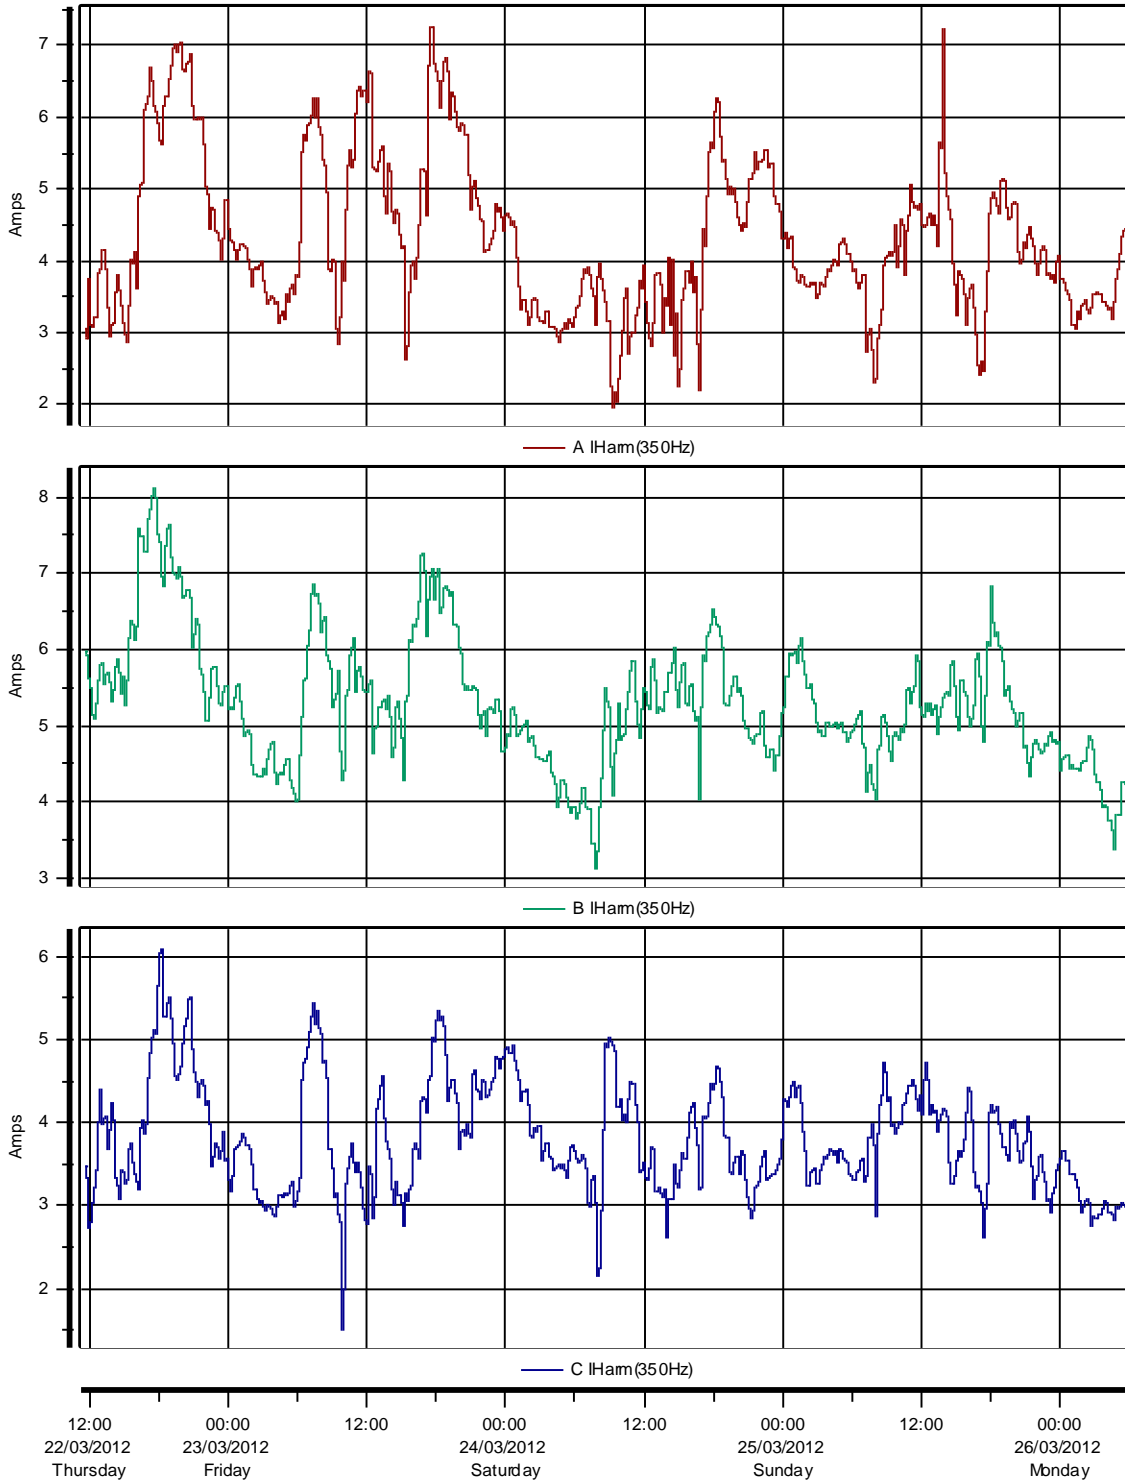


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 35 of 39

Timeplot
Current Spectra

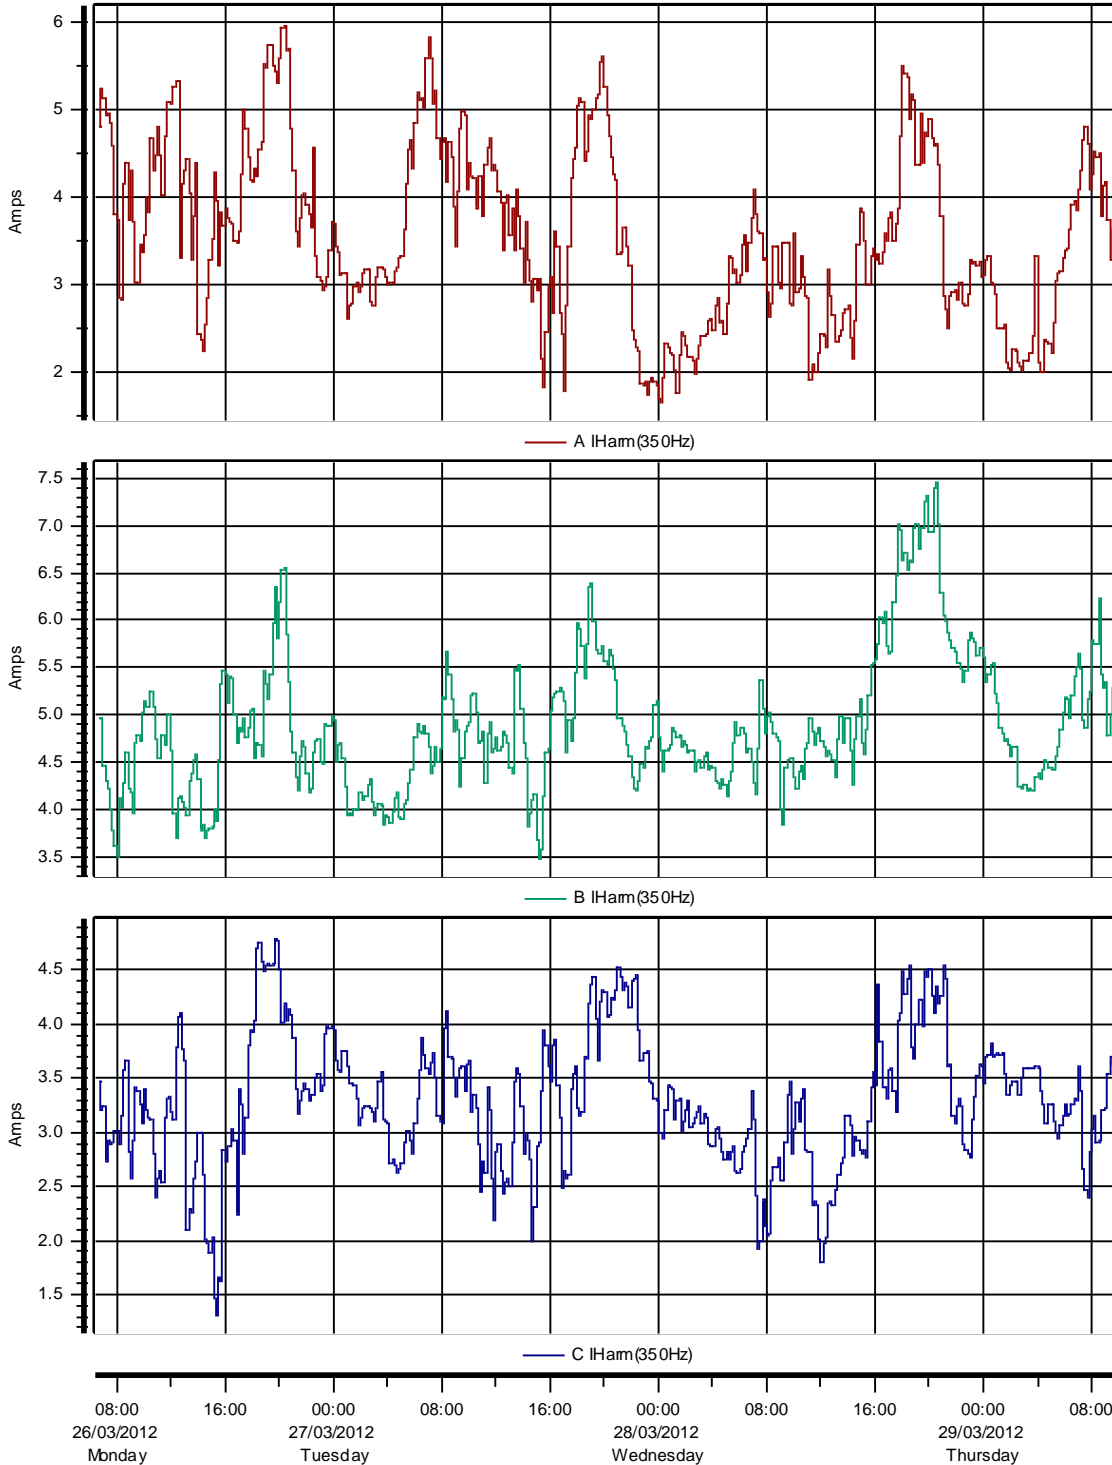


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 36 of 39

Timeplot
Current Spectra

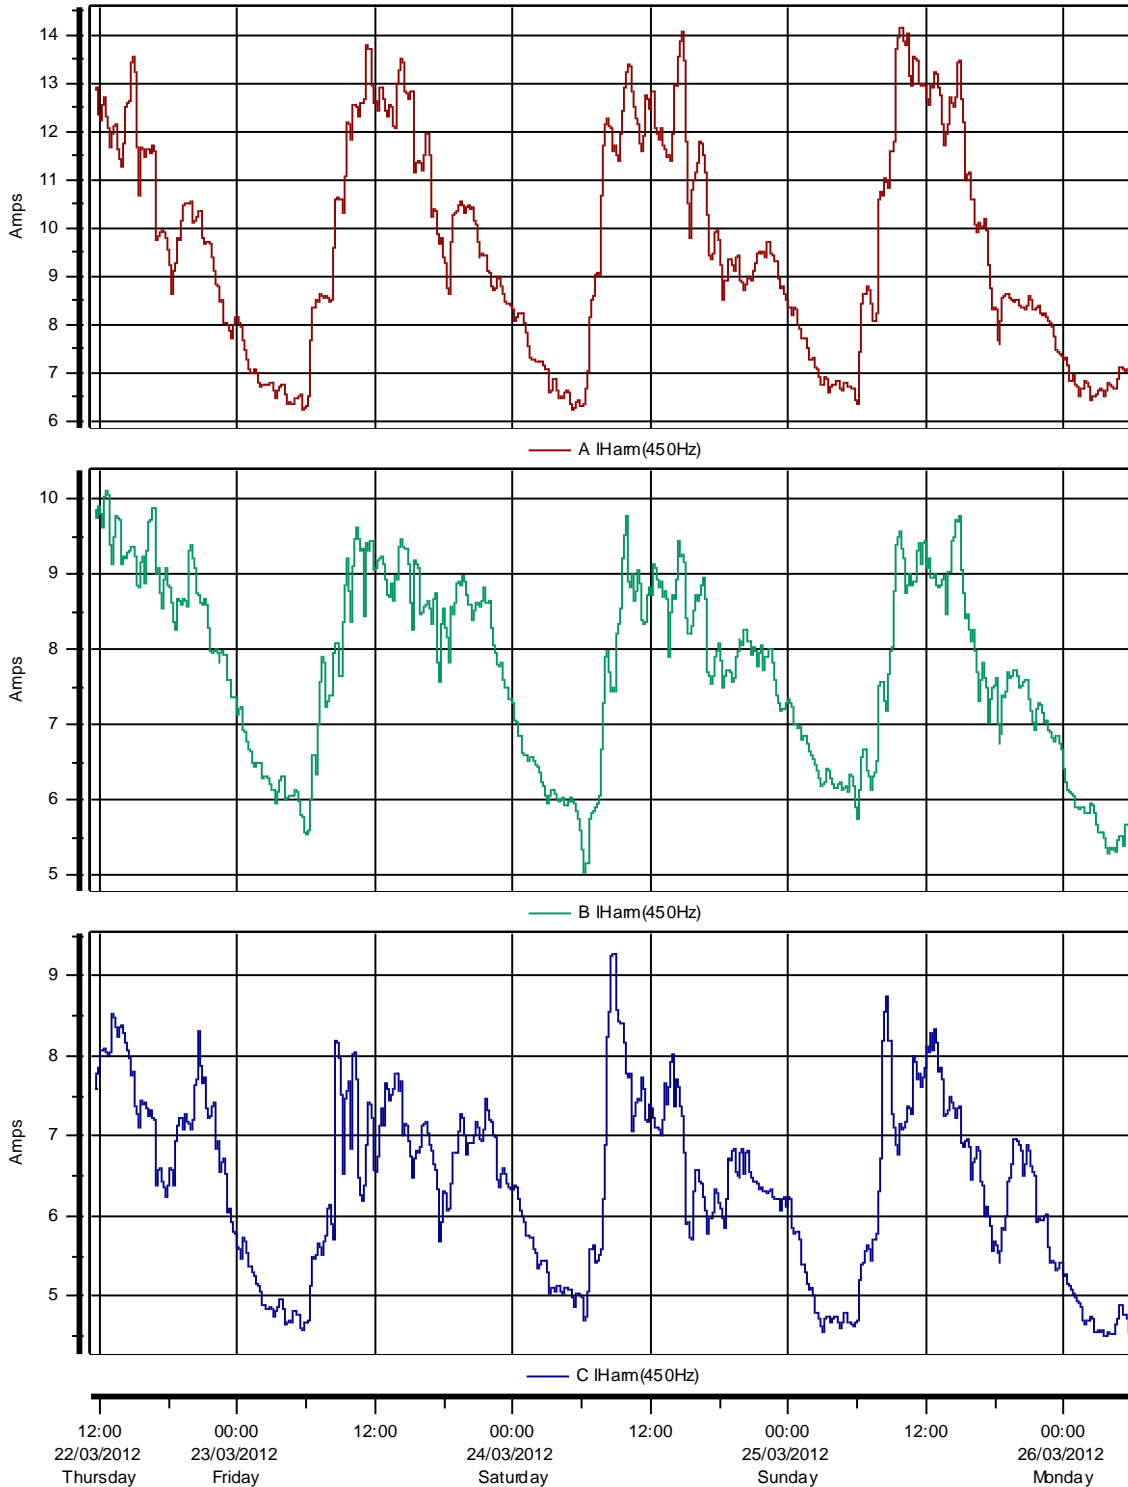


<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 37 of 39


Timeplot
Current Spectra

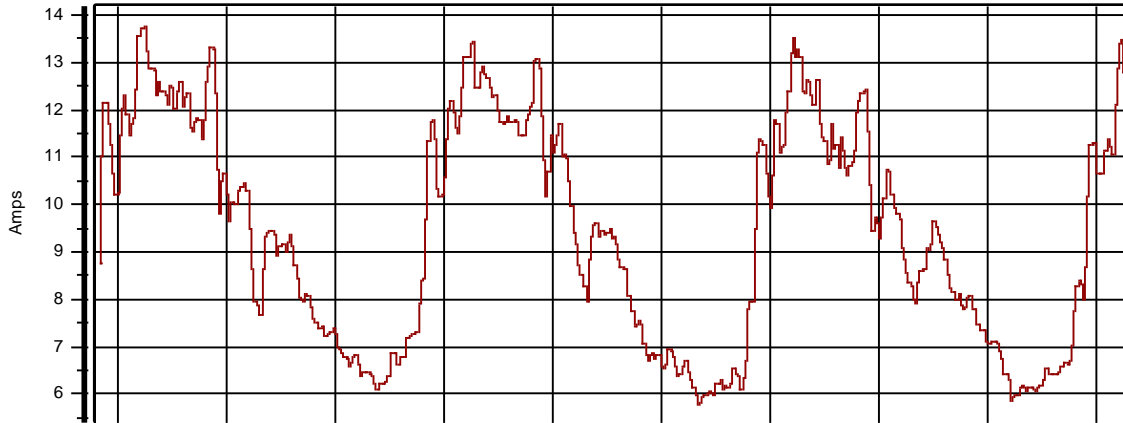

— A IHam(450Hz)

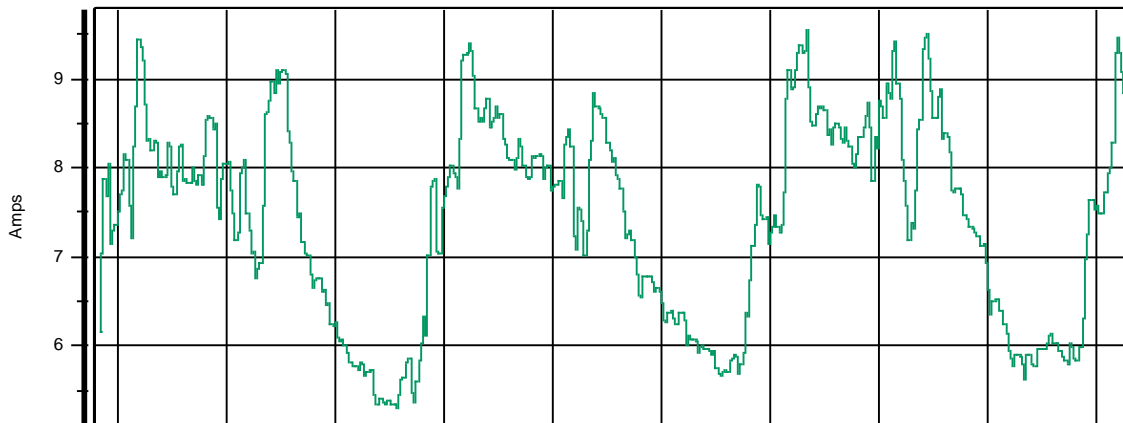

— B IHam(450Hz)

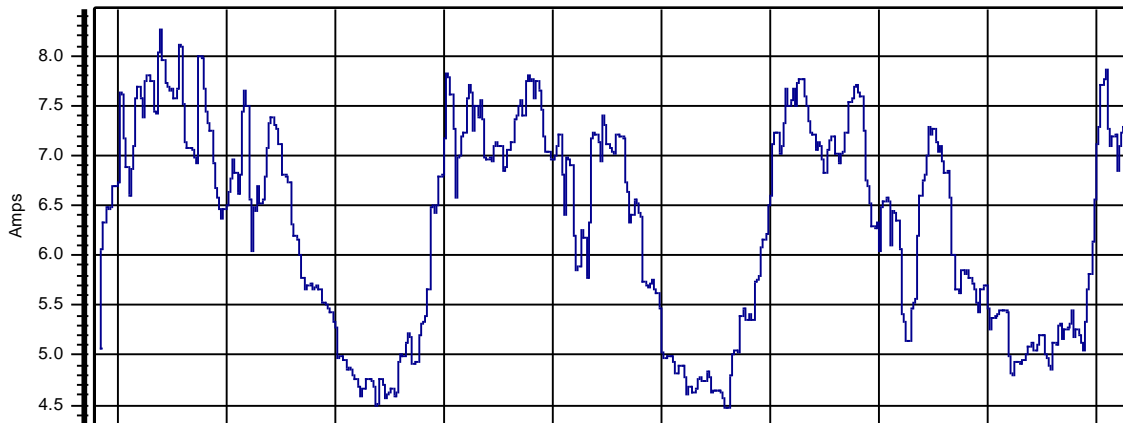

— C IHam(450Hz)

08:00 16:00 00:00 08:00 16:00 00:00 08:00 16:00 00:00 08:00
 26/03/2012 27/03/2012 28/03/2012 29/03/2012
 Monday Tuesday Wednesday Thursday

<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 38 of 39

HARMONICS COMPARED AGAINST LIMITS

Site: DUNTON GREEN

Measured from 22/03/2012 11:20:08.0 to 26/03/2012 06:30:20.0

G5/4 Stage 1 Curr. Harm. >16A per Phase

Measured Current Harmonics

	Limit	CHA	CHB	CHC	Status
H02	28.90 A	0.59	0.51	0.65	PASSED
H03	48.10 A	23.48	20.23	19.90	PASSED
H04	9.00 A	0.33	0.23	0.36	PASSED
H05	28.90 A	13.73	13.76	9.80	PASSED
H06	3.00 A	0.17	0.14	0.18	PASSED
H07	41.20 A	5.28	5.89	4.23	PASSED
H08	7.20 A	0.21	0.15	0.21	PASSED
H09	9.60 A	11.88	8.48	7.27	FAILED
H10	5.80 A	0.14	0.11	0.17	PASSED
H11	39.40 A	3.56	2.45	2.64	PASSED
H12	1.20 A	0.17	0.13	0.17	PASSED
H13	27.80 A	2.71	1.96	2.60	PASSED
H14	2.10 A	0.11	0.09	0.11	PASSED
H15	1.40 A	3.50	2.81	2.27	FAILED
H16	1.80 A	0.10	0.10	0.12	PASSED
H17	13.60 A	2.64	2.41	1.79	PASSED
H18	0.80 A	0.08	0.07	0.09	PASSED
H19	9.10 A	1.37	1.33	1.52	PASSED
H20	1.40 A	0.08	0.10	0.09	PASSED
H21	0.70 A	0.86	0.44	0.65	FAILED
H22	1.30 A	0.07	0.06	0.07	PASSED
H23	7.50 A	0.57	0.90	0.85	PASSED
H24	0.60 A	0.05	0.05	0.05	PASSED
H25	4.00 A	0.70	0.63	0.79	PASSED
H26	1.10 A	0.05	0.05	0.05	PASSED
H27	0.50 A	0.47	0.33	0.46	PASSED
H28	1.00 A	0.04	0.05	0.04	PASSED
H29	3.10 A	0.44	0.62	0.55	PASSED
H30	0.50 A	0.04	0.04	0.03	PASSED
H31	2.80 A	0.23	0.23	0.22	PASSED
H32	0.90 A	0.04	0.04	0.03	PASSED
H33	0.40 A	0.21	0.16	0.19	PASSED
H34	0.80 A	0.04	0.04	0.02	PASSED
H35	2.30 A	0.19	0.18	0.17	PASSED
H36	0.40 A	0.04	0.04	0.02	PASSED
H37	2.10 A	0.15	0.13	0.12	PASSED
H38	0.80 A	0.04	0.04	0.02	PASSED
H39	0.40 A	0.10	0.11	0.10	PASSED
H40	0.70 A	0.04	0.04	0.02	PASSED
H41	1.80 A	0.14	0.12	0.12	PASSED
H42	0.30 A	0.04	0.04	0.02	PASSED
H43	1.60 A	0.10	0.10	0.10	PASSED
H44	0.70 A	0.04	0.04	0.02	PASSED
H45	0.30 A	0.06	0.06	0.05	PASSED
H46	0.60 A	0.04	0.04	0.02	PASSED
H47	1.40 A	0.08	0.08	0.06	PASSED
H48	0.30 A	0.04	0.04	0.02	PASSED
H49	1.30 A	0.07	0.08	0.07	PASSED
H50	0.60 A	0.00	0.00	0.00	PASSED

<i>Customer</i> ENW		<i>ABB Ref.</i>	
<i>Project</i> Dunton Green Harmonic Survey		<i>Cust. Ref.</i>	
<i>Dealt with by</i> SCJ	<i>Date</i> 27/03/2014	<i>Issue</i> 0	<i>Page</i> 39 of 39

HARMONICS COMPARED AGAINST LIMITS

Site: DUNTON GREEN

Measured from 26/03/2012 06:30:40.0 to 29/03/2012 10:14:16.0

G5/4 Stage 1 Curr. Harm. >16A per Phase

Measured Current Harmonics

	Limit	CHA	CHB	CHC	Status
H02	28.90 A	0.64	0.47	0.60	PASSED
H03	48.10 A	21.61	20.41	18.94	PASSED
H04	9.00 A	0.35	0.22	0.34	PASSED
H05	28.90 A	15.10	13.74	10.37	PASSED
H06	3.00 A	0.17	0.14	0.17	PASSED
H07	41.20 A	4.10	5.40	3.61	PASSED
H08	7.20 A	0.17	0.15	0.22	PASSED
H09	9.60 A	11.76	8.15	7.04	FAILED
H10	5.80 A	0.14	0.11	0.16	PASSED
H11	39.40 A	3.34	2.17	2.44	PASSED
H12	1.20 A	0.16	0.14	0.17	PASSED
H13	27.80 A	2.92	1.93	2.68	PASSED
H14	2.10 A	0.11	0.10	0.11	PASSED
H15	1.40 A	3.46	2.92	2.20	FAILED
H16	1.80 A	0.09	0.10	0.12	PASSED
H17	13.60 A	2.43	1.98	1.92	PASSED
H18	0.80 A	0.08	0.08	0.09	PASSED
H19	9.10 A	1.24	1.36	1.34	PASSED
H20	1.40 A	0.08	0.09	0.09	PASSED
H21	0.70 A	0.66	0.58	0.69	PASSED
H22	1.30 A	0.06	0.06	0.07	PASSED
H23	7.50 A	0.53	0.80	0.85	PASSED
H24	0.60 A	0.05	0.05	0.06	PASSED
H25	4.00 A	0.72	0.61	0.85	PASSED
H26	1.10 A	0.05	0.06	0.05	PASSED
H27	0.50 A	0.40	0.36	0.46	PASSED
H28	1.00 A	0.04	0.05	0.04	PASSED
H29	3.10 A	0.41	0.57	0.57	PASSED
H30	0.50 A	0.04	0.04	0.03	PASSED
H31	2.80 A	0.25	0.26	0.25	PASSED
H32	0.90 A	0.04	0.04	0.03	PASSED
H33	0.40 A	0.19	0.17	0.16	PASSED
H34	0.80 A	0.04	0.04	0.02	PASSED
H35	2.30 A	0.16	0.15	0.18	PASSED
H36	0.40 A	0.04	0.04	0.02	PASSED
H37	2.10 A	0.14	0.14	0.11	PASSED
H38	0.80 A	0.04	0.04	0.02	PASSED
H39	0.40 A	0.10	0.09	0.11	PASSED
H40	0.70 A	0.04	0.04	0.02	PASSED
H41	1.80 A	0.15	0.13	0.14	PASSED
H42	0.30 A	0.04	0.04	0.02	PASSED
H43	1.60 A	0.11	0.11	0.11	PASSED
H44	0.70 A	0.04	0.04	0.02	PASSED
H45	0.30 A	0.07	0.06	0.06	PASSED
H46	0.60 A	0.04	0.04	0.02	PASSED
H47	1.40 A	0.08	0.08	0.05	PASSED
H48	0.30 A	0.04	0.04	0.02	PASSED
H49	1.30 A	0.07	0.08	0.07	PASSED
H50	0.60 A	0.00	0.00	0.00	PASSED